

National Fenestration
Rating Council

**National
Fenestration
Rating Council
Incorporated**

**NFRC 201:2001
Interim Standard Test Method for Measuring the Solar
Heat Gain Coefficient of Fenestration Systems Using
Calorimetry Hot Box Methods**

Copyright© NFRC

Published:	November 2002
Revised:	July 2003
Second Edition	

Prepared by:

National Fenestration Rating Council, Incorporated
8484 Georgia Avenue, Suite 320
Silver Spring, MD 20910
Telephone: (301) 589-1776
Facsimile: (301) 589-3884

Web Site: <http://www.nfrc.org>



Table of Contents

1.0	Scope	1
2.0	Referenced Document	2
2.1	ASTM Standards	2
2.2	ASHRAE/ANSI Standards	2
2.3	NFRC Standards	3
2.4	ISO Standards	3
3.0	Terminology	4
3.1	Definitions.....	4
3.2	Description of Terms Specific to this Standard.....	4
3.3	Symbols.....	6
4.0	Significance and Use	9
5.0	Calibration	13
5.1	Overall Calibration Requirements.....	13
5.2	Instrument Calibration	13
5.3	System Characterization	14
5.4	System Characterization Tests.....	15
5.5	System Verification Tests	17
6.0	Experimental Apparatus and Instrumentation	19
6.1	General Description of Measurement of Solar Heat Gain Coefficient	19
6.2	Description of Solar Calorimeter Cell	20
6.3	Solar Radiation Measurement	25
6.4	Measurement of Ambient Conditions	26
7.0	Test Procedure	27
7.1	Test Methodology	27
7.2	Test Specimen Installation	27
7.3	Test Conditions.....	29
7.4	Determination of Steady-State Conditions	31

8.0	Calculation Procedure	32
8.1	General Description of Calculation Procedure	32
8.2	Heat Transfer through Solar Calorimeter Shell	32
8.3	Heat Removed by Fluid Heat Extraction System	33
8.4	Heat Input by Fans and Pumps	33
8.5	Heat Transfer through the Test Specimen	34
8.6	Solar Irradiation Incident on the Test Specimen.....	35
8.7	Calculation of Solar Heat Gain Coefficient	36
9.0	Test Report	37
9.1	Reported Data	37
9.2	Uncertainty Estimation.....	38
10.0	Precision and Bias	40
11.0	Keywords	40
A1	SOLAR-AIR HEAT TRANSFER COEFFICIENT METER.....	41
A2	CALIBRATION OF SOLAR CALORIMETER WALL HEAT FLUX.....	45
A3	SURROUND PANEL FLANKING LOSS CALIBRATION.....	49
A4	RECOMMENDED PRACTICE FOR ESTIMATING THE TESTING SYSTEM TIME CONSTANT	50
A5	CALIBRATION TRANSFER STANDARD TESTS	55
A6	DESIGN AND CONSTRUCTION OF THE SOLAR CALORIMETER CALIBRATION AND SURROUND PANELS	56

1. Scope

- 1.1 This test method provides requirements, and guidelines, and specifies calibration procedures required for the measurement of the Solar Heat Gain Coefficient, *SHGC*, of fenestration systems installed in a solar calorimeter (hot box).
- 1.2 This test method applies to all fenestration systems, glazed apertures in buildings intended for the controlled admission of solar radiation. This includes windows, glazed doors, translucent panels, skylights, and glazing systems incorporating integral or attached shading devices such as insect screens, drapes, shades, and blinds.

NOTE 1: The methods described in this document may also be adapted for use in determining the SHGC of sections of totally opaque building wall, roof and floor assemblies containing thermal anomalies, which are smaller than the solar calorimeter metering area, but the results cannot be NFRC certified.

- 1.3 This test method specifies the necessary measurements to be made using solar calorimeters exposed to solar radiation under clear sky conditions (outdoors) or using artificial solar radiation (indoors). The test sample may be illuminated with either direct beam radiation only, or with direct beam plus diffuse sky and ground reflected radiation, as long as the method of irradiation is specified and the method employed satisfies the specifications within this document.
- 1.4 A discussion of the terminology and underlying assumptions for measuring the Solar Heat Gain Coefficient is included.
- 1.5 *This standard does not purport to address all of the safety problems, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices, and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 *ASTM Standards:*

- C 168 Terminology Relating to Thermal Insulating Materials¹
- C 177 Test Method for Steady-State Heat Flux Measurements and Thermal Transmission Properties by Means of the Guarded Hot Plate Apparatus²
- C 518 Test Method for Steady-State Thermal Heat Flux Measurements and Transmission Properties by Means of the Heat Flow Meter Apparatus²
- C 1045 Practice for Calculated Thermal Transmission Properties from Steady-State Heat Flux Measurements²
- C 1114 Test Method for Steady-State Thermal Transmission Properties by Means of the Thin-Heater Apparatus²
- C 1199 Test Method for Measuring the Steady-State Thermal Transmittance of Fenestration Systems Using Hot Box Methods²
- C 1363 Standard Method of Test for The Thermal Performance of Building Assemblies by Means of A Hot Box Apparatus²
- C 1371 Standard Test Method for Determination of Emittance of Materials Near Room Temperature Using Portable Emissometers²
- E 283 Test Method for Rate of Air Leakage Through Exterior Windows, Curtain Walls, and Doors Under Specified Pressure Difference Across the Specimen²
- E 631 Terminology of Building Constructions³
- E 772 Terminology Relating to Solar Energy Conversion³
- E 824 Test Method for Transfer of Calibration from Reference to Field Radiometers⁴
- E 1423 Practice for Determining the Steady-State Thermal Transmittance of Fenestration Systems³

2.2 *ASHRAE/ANSI Standards:*

- 41.1-1991: Standard Method for Temperature Measurement⁵.
- 93-1986: Methods of Testing to Determine the Thermal Performance of Solar Collectors⁵.
- 2001 Handbook of Fundamentals⁵

¹ *Annual Book of ASTM Standards, Vol 04.06.*

² *Annual Book of ASTM Standards, Vol 04.11.*

³ *Annual Book of ASTM Standards, Vol 12.02.*

⁴ *Annual Book of ASTM Standards, Vol 14.04.*

⁵ Available from ASHRAE Inc., 1791 Tullie Circle, NE, Atlanta, GA. 30329

2.3 NFRC Standards:

- NFRC 100: Procedure for Determining Fenestration Product U-factors⁶
- NFRC 200: Procedure for Determining Fenestration Product Solar Heat Gain Coefficients at Normal Incidence⁶
- NFRC 300: Procedures for Determining Solar Optical Properties of Simple Fenestration Product⁶

2.4 ISO Standards:

- ISO 9060: Solar Energy – Specification And Classification Of Instruments For Measuring Hemispherical Solar And Direct Solar Radiation⁵
- ISO 15099: Thermal Performance of Windows, Doors and Shading Devices — Detailed Calculations.⁵

⁶ Available from National Fenestration Rating Council, 8484 Georgia Avenue, Suite 320, Silver Spring, MD 20910.

3. Terminology

- 3.1 Definitions** - Definitions and terms are in accordance with definitions in Terminologies ASTM C 168, ASTM E 631, and ASTM E 772 from which the following have been selected and modified to apply to fenestration systems.
- 3.1.1 *air leakage*: The volume of air flowing per unit time through a test specimen because of air pressure or temperature difference on both sides of the specimen.
- 3.1.2 *fenestration system*: A fenestration is a glazed aperture in a building for the controlled admission of solar radiant heat and light. A fenestration system is a system of usually planar (but sometimes curved) transparent or translucent glazings, frames holding the glazing, mullions, muntin bars, dividers, and other attachments and/or shading devices that form the fenestration system. The glazing can include glass or plastic sheets that are patterned, corrugated, or otherwise distorted, so long as some visible light can pass through them. The fenestration system is often referred to as the test specimen in this document.
- 3.1.3 *standard barometric pressure*: Standard barometric pressure is 101.325 kPa (29.92 in. Hg).
- 3.1.4 *surface heat transfer coefficient, h* (sometimes called *surface conductance* or *film coefficient*): The time rate of heat flow from a unit area of a surface to its surroundings, induced by a unit temperature difference between the surface and the environment.
- 3.1.5 *time constant*: The time for power (flow rate $\cdot c_p \cdot \Delta T$) carried in the fluid leaving the test chamber to attain 1/e (63.2%) of its steady-state change following an instantaneous step change in the irradiance incident upon the test aperture.
- 3.1.6 *thermal transmittance, U_s* (sometimes called the overall coefficient of heat transfer or air-to-air U-factor): The heat transfer in unit time through unit area of a test specimen and its boundary air films, induced by unit temperature difference between the environments on each side. The U-factor is the inverse of the overall R-value.

3.2 Descriptions of Terms Specific to this Standard:

- 3.2.1 *air mass*: The ratio of the mass (optical thickness) of atmosphere in the actual observer-sun path to the mass that would exist if the observer was at sea level, at standard barometric pressure, and if the sun was directly overhead (at the zenith).
- 3.2.2 *angle of incidence*: The angle between the solar beam and the normal (perpendicular) to the plane on which it is incident. (The plane of incidence may be the aperture plane, the glazing plane, or any other plane of interest)
- 3.2.3 *Calibration Transfer Standard (CTS)*: An insulation board that is faced with glazing, instrumented with temperature sensors between the glazing and the insulation board core, which is used to calibrate the surface heat transfer coefficients and the surround panel (See Annex A1 in ASTM C 1199 for design guidelines for Calibration Transfer Standards). The thermal conductance of the insulation board core is known by measurement using ASTM C 177 or ASTM C 518.

- 3.2.4 *control boundary*: The system boundary is one of three elements, which comprise all thermodynamic systems. It is an imaginary surface, which divides the system volume and the surroundings. The calorimeter system boundary consists of an imaginary surface defined by the exterior surfaces of the surround panel and calorimeter walls.
- 3.2.5 *solar irradiance, global*: The solar irradiance incident upon an upward-facing horizontal surface directly from the solid angle of the sun's disk and scattered or diffusely reflected in traversing the atmosphere. This includes direct and diffuse solar radiation
- 3.2.6 *solar irradiance, average*: The time integral of solar irradiance incident on a unit surface area over a specified time period divided by the duration of that time period.
- 3.2.7 *solar irradiance*: The quantity of radiant flux incident upon a surface from all directions and over all wavelengths per unit area.
- 3.2.8 *profile angle*: The angular difference between a horizontal plane and a plane tilted about a horizontal axis in the plane of the fenestration until it includes the sun.
- 3.2.9 *pyranometer*: A radiometer used to measure the total solar radiant energy incident upon a surface per unit time per unit area. This energy may include the direct radiant energy, the diffuse sky radiant energy and the reflected radiant energy from the foreground.
- 3.2.10 *steady-state conditions*: state of the solar calorimeter test when the heat flow rate removed by the fluid flowing through the absorber plate, and the temperatures within the solar calorimeter and on the test specimen are constant. The exit fluid temperature changes are small and due to only the usual change in irradiance that occurs with time for clear sky conditions.
- 3.2.11 *Solar-Air Heat Transfer Coefficient Meter*: An insulated flat black plate, which is in the same plane and solar exposure as the test specimen that is used to measure the instantaneous exterior surface heat transfer coefficient (See Annex A1).
- 3.2.12 *solar calorimeter*: An insulated enclosure designed to permit the continuous introduction and extraction of a measured flow of fluid mass and equipped with an empty aperture into which a fenestration system is inserted for testing. During a test, solar radiation (or simulated solar radiation) is made to be incident upon the fenestration at a known rate. An energy balance performed over the calorimeter, which incorporates heat extracted by the fluid, wall losses, and power input to internal mechanisms, is indicative of the net energy gain (solar heat gain minus thermal losses) through the fenestration.
- 3.2.13 *Solar Heat Gain (SHG)*: The amount of solar heat gain into the space in question. Included are both directly transmitted solar radiation as well as solar energy absorbed by the fenestration system and re-transmitted into the inside space.
- 3.2.14 *Solar Heat Gain Coefficient (SHGC)*: The ratio of solar heat gain through the fenestration system per unit area to solar radiation incident on the system per unit area, for a given angle of incidence and for given environmental conditions (indoor temperature, outdoor temperature, wind speed and direction, solar radiation). The SHGC can be expressed as follows for single pane fenestration:

$$SHGC = \tau_s + N_i \cdot \alpha_s \quad (1)$$

where:

$SHGC$ = Solar Heat Gain Coefficient

τ_s = solar transmittance of fenestration system

N_i = inward-flowing fraction of absorbed radiation

α_s = solar absorptance of a single-pane fenestration system

3.2.15 *solar radiation*: Electromagnetic radiation covering the spectral range from 300 to 4000 nm coming from either natural direct beam solar radiation or from an artificial radiation source having a similar spectral distribution.

3.2.16 *surround panel* (sometimes called the *mask*, *mask wall*, or *homogeneous wall*): a uniform structure of homogeneous, low conductivity material that both supports the test specimen and provides a uniform, reproducible energy flux pattern at the edges of the solar calorimeter perimeter. (See Section 6.2.3 for a description of a surround panel.)

3.2.17 *test specimen*: (also called the *specimen*) the fenestration system or product being tested.

3.3 Symbols: The symbols, terms, and units used in this test method are as follows:

A_s	projected area of test specimen, (same as open area in surround panel), m^2
A_{sp}	projected area of surround panel, (does not include open area in surround panel), m^2
α_s	solar absorptance of surface
C_g	thermal conductance of glass or acceptable transparent plastic facing on Calibration Transfer Standard, $W/(m^2 \cdot K)$
C_{sp}	thermal conductance of surround panel (surface to surface), $W/(m^2 \cdot K)$, determined by means of ASTM C 177 and ASTM C 1045, ASTM C 518 and ASTM C 1045, or ASTM C 1114 and ASTM C 1045
C_{ts}	thermal conductance of Calibration Transfer Standard, $W/(m^2 \cdot K)$, determined by means of ASTM C 177 and ASTM C 1045, ASTM C 518 and ASTM C 1045, or ASTM C 1114 and ASTM C 1045
ϵ	emittance of surface
E_s	incident solar irradiance, W/m^2
F_{1b}	interior calorimeter radiative view factor
h_{h-sun}	exterior surface heat transfer coefficient, as measured on the Solar-Air Heat Transfer Coefficient Meter, $(W/m^2 \cdot K)$
h_{STh}	standardized surface heat transfer coefficient, calorimeter side, $(W/m^2 \cdot K)$
h_{STc}	standardized surface heat transfer coefficient, weather side, $(W/m^2 \cdot K)$
h_h	surface heat transfer coefficient, calorimeter side, $W/(m^2 \cdot K)$
h_c	surface heat transfer coefficient, weather side, $W/(m^2 \cdot K)$
θ	incident angle, degrees
θ_E	average incident angle, degrees
L	length of heat flow path, m

m	mass flow rate, kg/s
N_i	inward flowing fraction
Ψ	profile angle, degrees
Ψ_E	average profile angle, degrees
Q	time rate of heat flow through the total surround panel/test specimen system, W
Q_{aux}	time rate of heat flow into the solar calorimeter due to fans, heaters, or instrumentation, W
Q_c	time rate of convective heat flow from test specimen surface, W
Q_{env}	time rate of heat flow through the calorimeter walls, surround panel, and energy input by the fans and pumps, W
Q_{fl}	time rate of flanking loss heat flow around surround panel, W
Q_{fluid}	time rate of heat flow from the absorber plate into the fluid passing through it, W
Q_{net}	time rate of heat flow into solar calorimeter, W
Q_r	time rate of net radiative heat flow from test specimen surface to the surroundings, W
Q_s	time rate of heat flow through the test specimen, W
Q_{sp}	time rate of heat flow through the surround panel as determined from measured conductance C_{ts} and area weighted surround panel surface temperatures, W
$Q_{U-factor}$	time rate of heat flow through the test specimen due to a temperature difference across the unit, W
Q_{walls}	time rate of heat flow through the solar calorimeter walls due to a temperature difference between the inside and outside, W
q	heat flux (time rate of heat flow through unit area), W/m^2
q_s	heat flux through the test specimen, W/m^2
q_{r1}	net radiative heat flux to the calorimeter side of the test specimen, W/m^2
q_{r2}	net radiative heat flux from the weather side of the test specimen, W/m^2
q_{c1}	convective heat flux to the calorimeter side of the test specimen, W/m^2
q_{c2}	convective heat flux from the weather side of the test specimen, W/m^2
ρ	reflectance of surface
R_s	overall thermal resistance of test specimen (air to air under test conditions), $(m^2 \cdot K)/W$
SC	Shading Coefficient
SHGC	Solar Heat Gain Coefficient
ϑ_s	solar transmittance of fenestration system
t_{b1}	equivalent radiative baffle surface temperature, calorimeter side, K or $^{\circ}C$
t_h	average temperature of calorimeter side air, K or $^{\circ}C$
t_c	average temperature of weather side air, K or $^{\circ}C$
t_{sp1}	average temperature of calorimeter side of surround panel, K or $^{\circ}C$
t_{sp2}	average temperature of weather side of surround panel, K or $^{\circ}C$
t_1	average temperature of test specimen calorimeter side surface, K or $^{\circ}C$
t_2	average temperature of test specimen weather side surface, K or $^{\circ}C$

- t_1 average temperature of room side glass/core interface of calibration transfer standard, K or °C
- t_2 average temperature of weather side glass/core interface of calibration transfer standard, K or °C
- U_M modified thermal transmittance of test specimen [in the absence of the exterior surface heat transfer coefficient], $W/(m^2 \cdot K)$.
- U_S thermal transmittance of test specimen (air to air under test conditions), $W/(m^2 \cdot K)$
- U_{ST} standardized thermal transmittance of test specimen, $W/(m^2 \cdot K)$.

4. Significance and Use

- 4.1 This test method details the calibration and testing procedures, and necessary instrumentation required to measure the Solar Heat Gain Coefficient of fenestration systems installed in a solar calorimeter.
- 4.2 Since the irradiance, spectral distribution, incident angle of solar radiation, temperatures, and the surface heat transfer coefficients all affect the SHGC of many fenestration products, use of standardized conditions will assist in comparing results of tests performed at dissimilar test sites. Standardized test conditions for determining the thermal transmittance of fenestration systems are specified in Section 7.
- 4.3 Fenestration systems in buildings may accept solar radiation from the direct sun, the diffuse sky, and radiation reflected from the ground and surrounding objects. The solar radiation incident on an (indoor or outdoor) solar calorimeter during a test will be different from what a fenestration system installed in a building might experience.
- 4.3.1 Solar calorimeters that are located outdoors are often tilted to non-vertical orientations in an effort to minimize the variation of incident angle during the test period. This is important when testing the SHGC of fenestration systems, which produce different SHGC's at different incident angles (i.e. venetian blinds). When a solar calorimeter is tilted, the surface heat transfer coefficients of the test specimen differ from those experienced at a vertical orientation, and the test specimen's view of the sky and ground is different. The characteristics of the diffuse radiation from the sky can be very different from those of the diffuse radiation from the ground, depending on the solar angle, sky conditions, and the specific foreground within the view of the solar calorimeter. By tilting the solar calorimeter, the test specimen's view of the sky increases, and the view of the ground decreases, which may significantly change the irradiance, especially its spectral and angular distribution incident on the test specimen.

NOTE 2: Preliminary research⁷ has shown that the results from some solar calorimeters tilted beyond 60° from vertical should not be used to represent vertical test results. Unless the solar calorimeter has been calibrated and can demonstrate accurate results with a specimen tilted beyond 60° from vertical, tests shall not be performed with a tilt angle greater than 60°.

⁷ Collins, M.R., and Harrison, S.J., "The Effects of Calorimeter Tilt on the Inward-Flowing Fraction of Absorbed Solar Radiation in a Venetian Blind", *ASHRAE Transactions*, pp. 677-683, Vol. 107 (1), 2001.

- 4.3.2 The spectral distribution of both the direct and diffuse solar irradiation at the earth's surface can vary with location, season, and time of day⁸⁹. Although these variations are typically not significant when testing the SHG of clear or lightly tinted and uncoated glazing systems, they can influence the measured results if the test specimen has complex spectral or angular optical characteristics. For these reasons, the SHG results of these types of products measured at one outdoor laboratory may vary from the results measured at another outdoor laboratory in a different location. Also, the SHG results from the same laboratory on the same test specimen may vary based on the time of year, solar altitude angle, and/or time of day it was tested. The magnitudes of the errors that can be introduced from these variations are not large but can be significant, depending upon the degree of spectral and/or angular selectivity inherent in the optical properties of the test specimens used. Further research is required to assess these errors and find ways to reduce them. If the spectral characteristics of the test specimen are known, as well as that of the incident solar radiation (either by measurement or calculation) it should be possible to determine a correction factor to minimize these errors, but this procedure has been neither identified nor standardized.
- 4.3.3 Solar calorimeters that are located indoors may use an electric lamp, or a series of lamps, filters, and reflectors, (solar simulators) to approximate the characteristics of direct beam solar radiation from the sun, as transmitted through the Earth's atmosphere. Although the spectral distribution of the radiation from an artificial light source must meet the specifications outlined in Section 7.3.2.2, there will always be some differences between the spectral distribution of the radiation emitted by an artificial source, and the radiation from the sun transmitted through the Earth's atmosphere. These differences can produce different results for the same test specimen when measured with different solar simulators, and differences in measurements with a solar simulator and with real solar radiation.

In addition, solar calorimeters that are located indoors are usually not exposed to real or simulated diffuse irradiation from the sky and the ground. As a result, all of the incident solar radiation is contained in the direct beam. See Section 7.3.2.2 for methods to minimize the differences between artificial light sources and the actual solar radiation at the Earth's surface, and Section 9.1 for the minimum reporting requirements for indoor solar calorimeters.

⁸ McCluney, R. "Sensitivity of Optical Properties and Solar Gain of Spectrally Selective Glazing Systems to Changes in Solar Spectrum," *Proceedings of the 22nd Annual Solar Conference*, Washington, DC: American Solar Energy Society, 1995

⁹ McCluney, R., "Sensitivity of Fenestration Solar Gain to Source Spectrum and Angle of Incidence," *ASHRAE Transactions* 10 (June 1996)

- 4.3.4 Because of the possible spectral selectivity effects discussed in Sect. 4.3.2 and 4.3.3, differences have been noted between calorimeter measurements of a test specimen and calculations of the solar heat gain coefficient of that specimen made with widely used, two-dimensional, fenestration thermal performance rating software¹⁰¹¹¹² based on ISO 9050, and ISO 15099. These programs use an ASTM standard air mass 1.5 solar spectral distribution weighting function in its calculation of the SHGC. If the specimen is tested with a calorimeter either outdoors or indoors using real or simulated solar radiation having a spectral distribution significantly different from the ASTM standard, significant differences in measured and calculated SHGC values can result, depending upon the spectral selectivity of the test specimen. It has been found that the use of a more representative solar spectrum weighting function in the fenestration thermal performance rating software calculation can reduce the differences between calculation and measurement. Future versions of these fenestration thermal performance rating programs are expected to contain an option for changing the source spectrum to a more realistic one.
- 4.4 It should be noted that the interior surface heat transfer coefficient on the calorimeter side, h_h , as determined prior to testing a fenestration product by using an appropriately sized Calibration Transfer Standard (CTS), may differ from the interior surface heat transfer coefficient that exists inside of the solar calorimeter during a SHGC test. Fenestration systems usually have frame and sash surfaces, which introduce two- and three-dimensional convective heat transfer that results in variable surface heat transfer coefficients which differ from the CTS values. In addition, solar calorimeters that are located outside are often tilted to non-vertical orientations to keep the incident angle constant, and the surface coefficients will change with tilt angle. As a result of all these factors, the test specimen surface heat transfer coefficients will not be equal to those obtained with the non-framed, approximately two-dimensional Calibration Transfer Standard used as a reference under the same conditions. It should be recognized that this assumption of equality will not be accurate for all fenestration products, especially for high thermal transmittance products in which the surface heat transfer coefficients are a major portion of the overall thermal transmittance, and also for fenestration products with

¹⁰ Arasteh, D.K., Finlayson, E.U., and Hizenga, C, “WINDOW 4.1: A PC Program for Analyzing Window Thermal Performance”; LBNL 1994

¹¹ Enermodal Engineering, Ltd. “FRAME – A computer Program to Evaluate the Thermal Performance of Window Frame Systems”; Version 3.0, Enermodal Engineering, Ltd.

¹² Arasteh, D.K, Finlayson, E., Mitchell, R., Huizenga, C., & Curcija, D., “THERM 2.1 – A PC Program for Analyzing Two-Dimensional Heat Transfer Through Building Products”; LBNL, 1999

significant projection (e.g., skylights, roof windows, garden windows) for which the surface heat transfer coefficients are quite different from the CTS values.

- 4.5 The SHGC of a test specimen is affected by its three-dimensional shape and also by its size (since the glazing does not scale along with the frame). Care must be exercised when extrapolating to product sizes smaller or larger than the test specimen. Therefore, it is recommended that fenestration systems be tested at the recommended sizes specified in ASTM E 1423 or NFRC 100.

NOTE 3: This test method does not include separate procedures to determine the heat flows due to either air movement through the specimen or nighttime U-factor effects. As a consequence, the SHGC results obtained do not reflect the overall performance, which may be found in field installations due to temperature differences, wind, shading, air leakage effects, and the thermal bridge effects specific to the design and construction of the fenestration system opening. Since there are a wide variety of fenestration system openings in North American residential, commercial and industrial buildings, it is not feasible to select a “typical” surround panel construction in which to mount the fenestration test system. The selection of a relatively high thermal resistance surround panel, places the focus of the test on the thermal performance of the fenestration system alone. Therefore, it should be recognized that the thermal transmittance results obtained from this test method, for ideal laboratory conditions in a highly insulating surround panel, should only be used for fenestration product comparisons or as input to thermal performance analyses which also include solar, air leakage, and thermal bridge effects due to the surrounding building structure. To determine air leakage effects for windows and doors, refer to ASTM E 283, ASTM E 783 or ASTM E 1424. For thermal transmittance, refer to ASTM C 1199.

5.0 Calibration:

- 5.1 **Overall Calibration Requirements** - Calibration of the calorimeter is required on each separate system level. Before testing of actual fenestration can occur, the instrumentation and systems of the calorimeter shall be calibrated, and the operating characteristics of the calorimeter shall be determined.
- 5.2 **Instrument Calibration** - Calibration of individual instruments shall be performed prior to system calibration. While periodic calibration of some of these devices is prudent (e.g. pyranometers and flowmeters), recalibration of all devices may be impossible (e.g. surface temperature difference thermopiles imbedded in the calorimeter walls). Care should be taken to accurately characterize and document such instruments and sensors during the construction of the calorimeter. The method and frequency of the calibration of some of the primary instruments used in solar calorimeter testing are discussed below.
- 5.2.1 **Pyranometer Calibration** – Of all the instrumentation, maintaining the accuracy of the pyranometer is the most critical to the measurement of solar heat gain. Error in the measurement of the incident solar irradiation is directly proportional to the error in measuring the solar heat gain coefficient. Therefore, the pyranometer shall be calibrated using ASTM E 824 before use, and at a minimum frequency of once a year thereafter. ASTM E 824 calibrations shall be performed at normal incidence (Type C), and at a tilt angle of $40^\circ \pm 20^\circ$ from horizontal. Certain types of pyranometers, (e.g., black and white thermopile sensors) have been shown to have a more significant variation in their calibration coefficient during their initial years of use¹³, and therefore may require more frequent calibration over this period. A periodic comparison of the results from the solar calorimeter against the reference glazing test specimen specified in Section 5.5.2.1, and comparison of the primary pyranometer against other pyranometers, which are kept in a dark, thermally stable environment most of the time, can help identify variations in the pyranometer calibration coefficient over time.
- 5.2.2 **Fluid Temperature Difference** – The fluid temperature difference sensors shall be calibrated annually. Depending on the type of temperature sensors used, calibration of a multi-junction thermopile or RTD sensor may be required at more frequent intervals as identified by the instrument manufactures' specifications.
- 5.2.3 **Fluid Flow Rate** – The instrumentation used to measure the fluid flow rate shall be calibrated at least once a year. As a secondary check between calibrations, the flow rate can be easily verified using a stopwatch and a graduated or weighed bucket.

¹³ Wilcox, S. and Al-Abbadi, N., "Using Irradiance and Temperature to Determine the Need for Radiometer Calibrations," *Forum 2001: Proceedings of the ASES Annual Conference*, Washington, DC, April 2001

5.3 System Characterization

- 5.3.1 *Temperature Measurements* – The following temperature measurements are required during system calibration tests.
- 5.3.1.1 *Interior Surface Temperatures* – The temperatures of all interior solar calorimeter surfaces (baffles, absorber plate, etc.) exchanging heat with or in view of the calibration panel, surround panel, or test specimen shall be measured. In addition the surface temperatures on both sides of the calibration or surround panel shall be measured. All surface temperature-measurements shall be made using the temperature sensor attachment techniques and area weighing criteria specified in Section 6.10 of ASTM C 1363. Surface temperatures shall be measured to ± 1.0 °C (± 1.8 F).
- 5.3.1.2 *Surface Temperature Difference* – The temperature difference across the solar calorimeter walls (control boundary) shall be measured using multi-junction thermopiles or equivalent instrumentation (See Section 6.2.2.5.2). All surface temperature measurements shall be made using the temperature sensor attachment techniques and area weighing criteria specified in Section 6.5.4 of ASTM C 1363. See Annex A2 for more information on how to determine the solar calorimeter wall loss. The temperature sensors shall be capable of measuring a temperature difference to sufficient accuracy to allow wall losses to be determined within ± 1.0 W (± 3.4 Btu/h).
- 5.3.1.3 *Air Temperatures* – The average interior air temperature of the solar calorimeter shall be a defined measurement on a plane parallel with the surface temperature sensors on the surround panel. As a minimum requirement, this shall be the mean of measurements at three locations equidistant from the vertical centerline of the surround panel. All air temperatures shall be measured in accordance with Section 6.10 of ASTM C 1363. Special care needs to be taken with air temperature sensors located in direct sunlight as they need to be shielded from effects of solar irradiation. A thin-walled aluminum shield painted white on the outside and inside surfaces and typically measuring up to 50 mm (2 in.) in diameter by 100 mm (4 in.) long placed around the bead and leading wire of the thermocouple has been shown to be adequate for this purpose, although some have successfully used shields that are smaller in dimension or made of specularly reflecting aluminum. In addition the ambient air temperature near the solar calorimeter shall be measured in at least one location at a distance not to exceed 2 meters (6 feet) from the solar calorimeter. The ambient air temperature sensor shall be placed at a location that is shaded from direct solar irradiation. Air temperatures shall be measured to ± 1.0 °C (± 1.8 F).
- 5.3.1.4 *Fluid Temperature Difference* – The temperature difference between the fluid flowing into the solar calorimeter and the fluid exiting the solar calorimeter shall be measured by a multi junction thermopile or equivalent device. The temperatures of the inlet and outlet fluid shall also be measured at a location central in the flow. The temperature sensors shall be capable of measuring temperature differences within ± 0.05 °C (± 0.09 F).

NOTE 4: The temperature sensor requirements given in Section 5.3.1 and Subsections 5.3.1.1 through 5.3.1.4 are general requirements. Section 7.2.4 on test specimen temperature measurements may suggest additional temperature sensors, dependent on the test specimen type. More temperature sensors shall be used if they provide a more representative area-weighted average temperature (air and surface).

- 5.3.2 *Fluid Flow Rate Measurements* – The flow rate of the fluid flowing through the solar calorimeter heat exchanger shall be measured by instrumentation or methods accurate to $\pm 1.0\%$. Alternatively, the mass of fluid through the heat exchanger over a measured time interval and the time interval shall be measured by instrumentation or methods accurate to $\pm 1.0\%$
- 5.3.3 *Miscellaneous Power Input* – Power provided to the calorimeter to operate internal pumps, fans, or other electrical equipment shall be measured. Power levels shall be determined to within $\pm 1\text{ W}$ ($\pm 3.4\text{ Btu/h}$) or $\pm 1.0\%$ of reading, whichever is most accurate.
- 5.3.4 *Irradiance Measurements* – The level of solar irradiance shall be determined. Irradiance measuring devices shall be calibrated to $\pm 2.0\%$ accuracy as specified in Section 5.2.1. See Section 6.3.1 for a more detailed description of the minimum requirements of pyranometers or similar solar irradiation measuring devices.
- 5.4 ***System Characterization Tests*** – The following four calibration test procedures shall be followed to characterize the performance of the solar calorimeter cell. Two of the calibration tests require that a calibration panel or continuous surround panel (the test specimen aperture is filled with the same material as the rest of the surround panel) be tested under different test conditions. Three calibration tests are performed under “night-time” conditions, without the influence of solar irradiation, and the remaining calibration test is performed with actual test specimens under full solar irradiation.
- 5.4.1 *General System Calibration Requirements* – The following equipment and set-up is required for system calibration tests.
- 5.4.1.1 *Calibration Panel or Surround Panel* – The solar calorimeter wall calibration test and the surround panel flanking loss tests require that a continuous surround panel or calibration panel (one without the test specimen aperture cut in it) be installed in the solar calorimeter with temperature sensors attached to both sides as specified in Annex A6. A surround panel (one with the test specimen aperture cut in it) is required for the time constant calibration tests, and the reference specimen tests. See Annex A6 for more detailed information on how to construct and instrument a surround panel and calibration panel.
- 5.4.1.2 *Air Leakage* – All potential air leakage sites on the calibration and surround panel, and at the interface between the panel and the solar calorimeter, shall be sealed with tape and/or caulking as close to the primary seal as possible to minimize or eliminate air leakage between the interior of the solar calorimeter and the outside. The surface emittance and solar absorptance of the tape or caulk shall be similar to (± 0.1) the emittance and solar absorptance of the surround panel surface. If the

surround panel is assembled from different pieces of the same material, the joints between surround panel pieces shall be sealed on both sides of the surround panel. In no case shall the tape or caulk cover more than 25 mm (1 in.) on each side of the surround panel edge.

NOTE 5: As an additional precaution to minimize the potential for leakage of air through and around the sealed test specimen, means may be provided to measure and equalize the pressure difference across the test specimen. See Section 7.1.3 of ASTM E 1423 for additional information on how to equalize the pressure difference across the test specimen.

- 5.4.1.3 *Heat Input Measurement and Instrumentation* – To perform the solar calorimeter wall calibration tests as specified in Annex A2, heat lamps or similar devices are placed inside of the calorimeter to produce a power input within the solar calorimeter. The heat source shall be centered in the interior space of the solar calorimeter, and be situated as to fully irradiate the solar absorber plate, without exchanging heat by radiation with the surround panel. The total energy input to the inside of the solar calorimeter shall be measured and recorded by instrumentation accurate to $\pm 1.0\%$
- 5.4.2 *Calibration of Solar Calorimeter Wall Heat Flux* – The initial calibration test requires that the calorimeter is able to accurately determine the power input to the calorimeter when little to no inside/outside temperature gradient exists. This calibration is actually a series of tests that are used to define the relationship between heat transfer through the walls of the solar calorimeter, and the output from the heat flux transducers or thermopile used to measure the temperature difference or heat flux across the calorimeter walls. Annex A2 describes the theory and methodology used to perform the solar calorimeter wall heat flux calibration tests, which are required before additional calibration and testing is performed.
- 5.4.3 *Surround Panel Flanking Loss Calibration* – The surround panel flanking loss calibration test method is described in detail in Annex A3. The surround panel flanking loss shall be determined using the procedure specified in Annex A3 for each thickness and construction of surround panel. For this calibration test, the temperature of the outdoor face of a calibration panel, which is constructed of the same material as the surround panel, is maintained at a higher temperature than the interior air temperature within the solar calorimeter. This test is performed under full sunlight with a calibration panel installed in the calorimeter. See Annex A3 for a complete description on how to determine the surround panel flanking loss of each surround panel.
- 5.4.4 *Time Constant Determination* – To establish when steady-state conditions occur it is necessary to determine the time constant of the solar calorimeter cell, surround panel and specimen. Annex A4 specifies the methodology used to measure the time constant of the solar calorimeter apparatus, and a means to estimate the time constant of the test specimen. The minimum time constant that can be used during actual tests shall not be less than 10 minutes.

- 5.5 *System Verification Tests* – After the initial calibration tests have been performed, tests of well-characterized test specimens shall be conducted to confirm the expected performance of the calorimeter cell. The previous calibration tests require that calibration panels, and glazing systems be tested under different test conditions. These additional tests shall be conducted using a Calibration Transfer Standard (CTS), and reference glazing test specimens, which shall both be installed in an aperture cut in the surround panel.
- 5.5.1 *Internal Surface Heat Transfer Coefficient*
- 5.5.1.1 The test facility surface heat transfer coefficient shall be calibrated using a heat flux transducer Calibration Transfer Standard constructed as described in Annex A1 of Test Method C 1199. The Calibration Transfer Standard has a core material of known characteristics traceable to primary standards such as the guarded hot plate of a national standard laboratory. The projected area of the Calibration Transfer Standard shall cover the same range as the test specimen model size and tolerance as specified in NFRC 100. If the solar calorimeter is to be used at non-vertical orientations, a minimum of three CTS tests shall be performed covering the range of tilt angles encountered during testing. See Annex A5 for the required standard temperatures, surface heat transfer coefficients and tolerances. Solar calorimeters using a Solar-Air Heat Transfer Coefficient Meter as described in Annex A1 shall not be required to satisfy the exterior surface heat transfer coefficient tolerance. See Annex A5 for a detailed description of how to perform the Calibration Transfer Standard tests.
- 5.5.2 *Real System Tests* - These tests shall be conducted in full sun using the procedures outlined in Sections 7 and 8.
- 5.5.2.1 *General Description* – Data taken from a calorimeter shall be compared to at least one well-characterized test specimen, called a *reference specimen* or *reference glazing*. At a minimum, one of the reference glazings specified in the following section shall be tested. In this manner, the calorimeter performance and calculation procedure can be verified. These tests should be performed after any equipment modification.
- 5.5.2.1.1 *Reference Glazing Test* – A reference glazing test specimen shall be constructed consisting of either single pane nominal 3 mm (1/8”) glass, or two panes of nominal 3 or 6 mm (1/8” or 1/4”) clear glass with a 12 mm (1/2”) air gap. The 3 mm glass shall have a solar transmittance, τ_s , of 0.84 ± 0.02 , and the 6 mm glass shall have a solar transmittance of 0.78 ± 0.02 as determined by NFRC 300. The use of double glazing reduces the effects of exterior wind direction and speed, and clear glass minimizes the effects of absorbed solar radiation in the test specimen, as well as spectral selectivity effects. If possible, the reference glazing test specimen should not have a frame, and should be installed with glazing stops made from the same material as the surround panel. For structural reasons, wood may be used sparingly as a frame, or as glazing stop material if it is painted white with a solar absorptance equal to or less than 0.2.
- 5.5.2.1.2 *Reference Specimen Size* – The reference specimen or glazing test specimen shall have sufficient size as to reduce uncertainty in the calculated SHGC. It shall not have less than 508 mm x 508 mm (20" x 20") of visible area when installed in the

- surround panel.
- 5.5.2.1.3 *Test Procedure* – The test procedure shall be performed as described in Section 7 and 8. The calibration test specimen shall be tested at as close to normal incidence as possible.
- 5.5.2.1.4 *Expected Results* – Clear single pane nominal 3 mm (1/8”) thick glass has a SHGC of 0.87. For the double glazed calibration test specimen at normal incidence, the SHGC shall be 0.75 for the nominal 3 mm (1/8”) thick glass, and 0.70 for the nominal 6 mm (1/4”) thick glass. SHGC results for other incident angles can be found in Table 11 of ASHRAE Handbook of Fundamentals (Chapter 31). Tested results shall not vary from those expected by more than $\pm 2\%$.
- 5.5.2.1.4.1 SHGC for other fenestrations are well documented in Table 11 of ASHRAE Handbook of Fundamentals (Chapter 31), or can be calculated using approved NFRC 200 software.

6. Experimental Apparatus and Instrumentation

6.1 General Description of Measurement of Solar Heat Gain Coefficient

- 6.1.1 Solar calorimetry, by definition, is composed of power measurements (energy flux per unit time) made across a defined, closed *control boundary*, which includes a test specimen and the calorimeter enclosure (or *calorimeter cell*). The equipment for control of the interior thermal conditions supplies a metered power across the control boundary. All other power fluxes across the control boundary (with the exception of that across the test specimen) should be minimized and shall be measured and documented.
- 6.1.2 The principal components used in the determination of SHGC by calorimetric methods (shown in Fig. 1) may be generalized as: [1] test specimen, [2] calorimeter cell and surround panel, [3] cell interior heat exchanger (or absorber), [4] thermal loop, and [5] external solar band radiation source. Systems to measure the energy flux across sections of the control boundary are also an integral part of the apparatus.

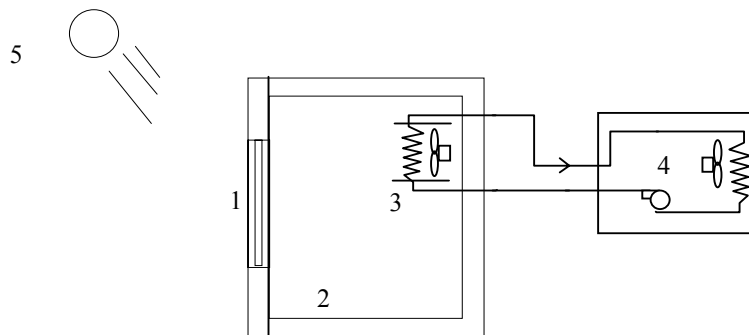


Figure 1: Typical components used in a calorimeter apparatus.

- 6.1.3 The function of the calorimeter enclosure is to provide a controlled thermal environment (simulating the interior space within a building), and to collect incoming solar and long-wave radiation. The calorimeter usually consists of this insulated enclosure with an aperture in which the fenestration test specimens are mounted, and the heat removal measured. Design options used in the construction of calorimeter cells are described in Section 6.2.1.
- 6.1.4 The air temperature within the calorimeter cell is typically controlled at a specified value through the combined use of a heat exchanger and circulation loop. These devices function to remove the incoming heat (slightly less or more in a servo loop) in order to maintain the cell conditions at the desired state. In the case of a liquid circulation loop, this may be accomplished by controlling fluid inlet temperature and flow rate. Low-power fans and auxiliary heaters may also be used to achieve more uniform temperature distributions and air flow within the test cell as long as their power inputs are measured.
- 6.1.5 During calorimeter testing, either the sun or an artificial solar source irradiates the fenestration test specimen. Simulated solar irradiation is used to allow testing under stable and repeatable conditions without sunshine. The intensity, uniformity, direction

and spectral characteristics of natural and artificial sunshine are important issues, and are discussed in Section 7.3.2.1.

- 6.1.6 Measurement instrumentation typically consists of temperature sensors, radiometers to measure total and direct normal solar radiation and long-wave thermal radiation, exterior film coefficient or wind speed transducers, and envelope heat flux sensors. See Sections 6.3 and 6.4 for the instrumentation requirements.

6.2 Description of Solar Calorimeter Cell

- 6.2.1 *Design Options* – There is a significant range in the design of calorimeters, primarily driven by the nature of the measurement intended. In general, these design options can be described by differing degrees of their capabilities.
- 6.2.1.1 *tracking vs. stationary* – Calorimeter test cells may be stationary or designed to track the sun as it sweeps across the sky during the day. This latter capability is intended to reduce variations in the intensity of the radiant energy due to the dependence of transmittance on incident angle.
- 6.2.1.2 *guarded vs. calibrated* – To account for energy losses or gains through the calorimeter walls, calorimeter designs generally follow one of two basic design approaches, which are referred to as "calibrated" or "guarded" designs. Calibrated designs rely on careful calibration (measurement) of the heat losses from the calorimeter, and usually involve the use of heat-flux meters or temperature sensors embedded in sections of the calorimeter walls to determine losses. Guarded calorimeter cells attempt to eliminate the temperature difference across the calorimeter wall, thereby reducing heat losses to negligible levels. Techniques for guarding include the use of air guards that are separately air-conditioned spaces surrounding the test facility, fluid guards that are heated or cooled by a separate fluid flow loop, or the use of actively controlled surface heaters attached to the exterior of the metering cell's walls.
- 6.2.1.3 *dynamic vs. steady-state* – Dynamic test methods allow the solar and environmental conditions to vary during the test period, and as such shall account for the storage or release of energy within the calorimeter and test specimen. Steady-state methods require the calorimeter to come to thermal equilibrium before measurements are recorded, and remain at that condition during data collection periods.
- 6.2.2 *Solar Calorimeter Wall Construction, Absorber Plate, and Instrumentation* – A cross section diagram of the walls of a calorimeter cell would show an interior absorber plate with an integral heat removal system (liquid), insulation, temperature and heat flux instrumentation, optional guard or surface heaters, and an exterior rigid shell. The absorber plate need not be part of the calorimeter wall. It can be separate or suspended to allow better convective heat transfer as well as heat absorption by radiation. The better contact the absorber has with the air in the calorimeter cell, the closer the air temperature will be to the heat exchanger surface, thus reducing thermal radiation effects. The absorber plate shall completely shade the calorimeter cell walls from solar radiation.
- 6.2.2.1 *Interior Air Temperature Instrumentation* – The average air temperature for the calorimeter interior shall be a defined measurement in a plane parallel with the surround panel and test specimen, at a distance of 75 mm (3 in) from the interior side of the surround panel.

- 6.2.2.1.1 As a minimum requirement, this shall be the mean of measurements at three locations equidistant from the vertical centerline of the surround panel. All air temperatures shall be measured in accordance with Section 6.10 of Test Method C 1363. More air temperature sensors may be used. Any additional air temperature sensors shall be placed in an array of equally spaced locations in a plane parallel with the surround panel at a distance of 75 mm (3 in) from the interior side of the surround panel.
- 6.2.2.1.2 The temperature sensors used shall be thermocouples (24 gage may be used, 30 gage or smaller are recommended), or appropriate size thermistors or RTD's (resistance temperature devices). Air temperatures shall be measured to $\pm 1.0\text{ }^{\circ}\text{C}$ ($\pm 1.8\text{ }^{\circ}\text{F}$).
- 6.2.2.1.3 Air temperature sensors illuminated by direct or diffuse solar radiation shall be either shielded from solar radiation, or shall have bright metallic surfaces, small sizes, and mechanical and material properties designed to reduce measurement errors produced by radiative heat transfer. Temperature sensors exposed to heat exchanger surfaces within the calorimeter shall be similarly shielded from radiative heat transfer.
- 6.2.2.2 *Interior Air Temperature Control* – The interior air of the calorimeter shall be maintained at the temperature specified by the appropriate test practice (i.e., NFRC 200).
- 6.2.2.2.1 The air in the calorimeter shall be maintained at a spatially constant temperature. There shall be no more than 2.0°C (3.8°F) of temperature stratification per meter from top to bottom of the interior height of the solar calorimeter measured along the plane parallel to the surround panel, and at a distance of 75 mm (3 in.) from the surround panel surface.
- 6.2.2.2.2 The spatially averaged air temperature in the calorimeter shall remain constant within $\pm 2.0^{\circ}\text{C}$ ($\pm 3.6^{\circ}\text{F}$) during the measurement period.
- 6.2.2.2.3 The circulating air flow inside the calorimeter shall at no point exceed 0.3 m/s (0.7 mph). If variation of the flow rate adjacent (measured at a distance of 75 mm (3 in.) from the inside surround panel surface) to the test specimen exceeds 0.1 m/s (0.2 mph) steps shall be taken to insure the uniformity of the air flow.
- 6.2.2.3 *External Electrical Power Instrumentation* – The total energy transmitted to the inside of the solar calorimeter by auxiliary heaters, fans or pumps shall be measured by instrumentation accurate to $\pm 1.0\%$ of reading or $\pm 1\text{ W}$ ($\pm 3.4\text{ Btu/h}$), whichever is most accurate.
- 6.2.2.4 *Interior Solar Calorimeter Walls and Absorber Plate* – The interior walls of the calorimeter are heavily insulated or else guarded, to reduce heat transfer. The absorber plate is constructed from metal or other highly conductive material, which is in contact with a physical means for removing and measuring absorbed heat. Sometimes, the interior walls of the solar calorimeter themselves are designed to incorporate an interior absorber plate skin. However, the absorber plate may also be freestanding within the calorimeter cell. The methodology used to suspend or support the absorber plate shall be designed and constructed as to minimize conducted heat transfer from the absorber plate into the calorimeter walls. The absorber plate shall completely shade the calorimeter cell walls from solar radiation. The heat extraction system is discussed in greater detail in Section 6.2.4.
- 6.2.2.4.1 The absorptance of the interior surfaces of the calorimeter enclosure to (solar spectral bandwidth 300 to 3,500 nm) shall be not less than 0.94. The determination of its value shall be made by measurement, according to ASTM E 903 or NFRC 300.

- 6.2.2.4.2 The emittance of the interior surfaces of the calorimeter enclosure shall be determined by measurement using ASTM C 1371 or NFRC 301, and shall be not less than 0.90.
- 6.2.2.4.3 *Interior Surface Temperatures* - The temperatures of all interior solar calorimeter surfaces (baffles, absorber plate, etc.) exchanging heat with or in view of the surround panel and test specimen shall be measured. All surface temperature measurements shall be made using the temperature sensor attachment techniques and area weighing criteria specified in Section 6.10 of ASTM C 1363. Surface temperatures shall be measured to $\pm 1.0\text{ }^{\circ}\text{C}$ ($\pm 1.8\text{ }^{\circ}\text{F}$).
- 6.2.2.5 *Insulated Walls of Solar Calorimeter* – The calorimeter walls are typically insulated with fiberglass or polystyrene foam (bead board). The insulation is placed between the absorber, and the guard space, guard heaters, or exterior shell of the solar calorimeter. The insulation shall be instrumented with temperature difference sensors to determine the heat flux through the walls during the test. These temperature difference sensors may be located across the wall of the solar calorimeter.
- 6.2.2.5.1 The solar calorimeter wall insulation shall consist of a stable homogeneous insulation material with a thermal conductance at $24\text{ }^{\circ}\text{C}$ not in excess of $0.04\text{ W}/(\text{m}\cdot\text{K})$ and having very low gas permeability.
- 6.2.2.5.2 The inside-outside temperature difference across the chamber walls shall be measured using multiple junction thermopiles or equivalent instrumentation. The thermopile wires shall be embedded in the walls in such a way that there is no direct heat transfer path through the chamber walls. The temperature sensors shall be capable of measuring a temperature difference to sufficient accuracy to allow wall losses to be determined within $\pm 1.0\text{ W}$ ($\pm 3.4\text{ Btu/h}$).
- 6.2.2.6 *Guarded Solar Calorimeter* – Guarded test cells effectively eliminate the temperature difference across the calorimeter cell wall, reducing heat losses to very low levels. Techniques for guarding include the use of fluid guards (Fig. 3), air guards, which are separately air-conditioned spaces surrounding the calorimeter cell, or the use of actively controlled surface heaters attached to the exterior of the metering cell's walls (Fig. 2). This latter method is less bulky and therefore more practical for facilities that are designed to track the sun.

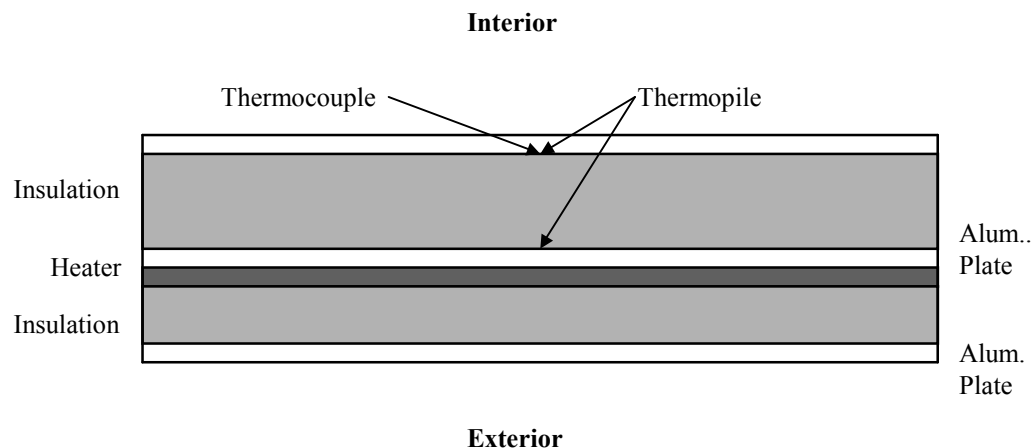


Figure 2 – Cross Section of Solar Calorimeter Wall Using Electric Heater Guard

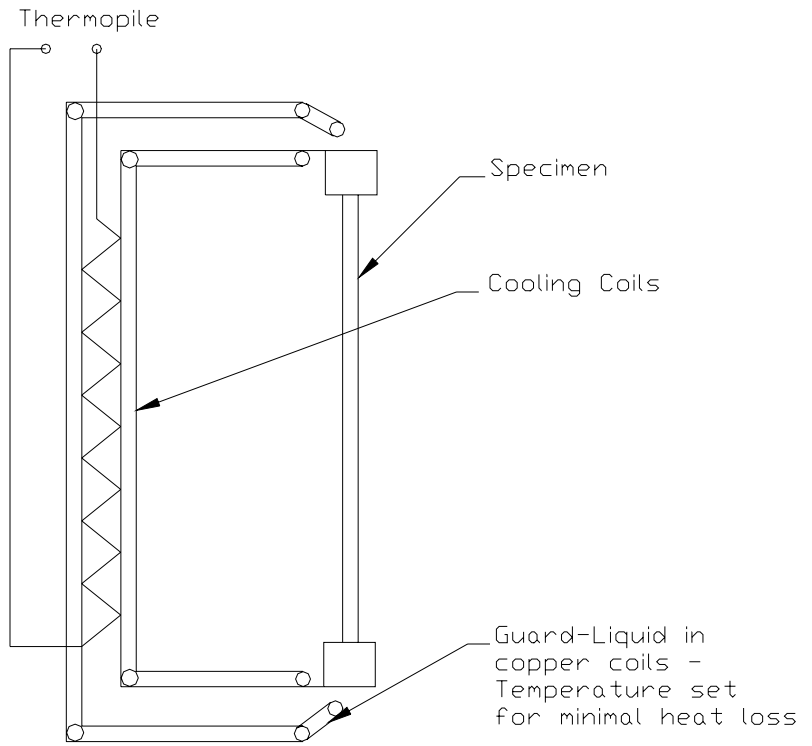


Figure 3 – Schematic of Actively Guarded Solar Calorimeter Using Fluid Heater Guard

- 6.2.2.7 *Exterior Shell of Solar Calorimeter* – The solar calorimeter is covered with an exterior shell with a low solar absorptance, which protects the insulation and instrumentation from the influence of solar radiation and weather, and often provides structural support to the solar calorimeter. Solar calorimeters located outdoors shall be painted white, or other color with low solar absorptance, to reduce the influence of direct sunlight on the exterior wall during the test. An additional strategy to minimize the effects of direct solar irradiation on the sides of the solar calorimeter is to construct a 15 to 30 cm (6 to 12 in.) wide, white shade in the plane of the exterior face of the surround panel, which surrounds and protrudes from the perimeter of the solar calorimeter. This will only shade the walls of the calorimeter when it is facing the sun. This shade shall be designed so that it does not interfere with the operation of the Solar-Air Heat Transfer Coefficient Meter described in Annex A1.
- 6.2.3 *Surround Panel and Instrumentation* – Test specimens are installed in surround panels that have been previously characterized using the calibration test procedures specified in Section 5. Surround panels are constructed and instrumented as specified in Annex A6.
- 6.2.4 *Heat Extraction System and Instrumentation* – The walls of a calorimeter cell consist of an interior absorber plate with an integral heat removal system. Solar calorimeters receive significant energy from solar radiation transmitted through, and absorbed by the test specimen. The interior air and walls of the calorimeter cell would quickly heat up if this heat was not removed. The absorbed solar energy is removed by transferring the heat, either by direct conduction from the solar absorption surface or by an air-to-fluid heat exchanger, or both, to a suitable flowing heat transfer fluid. The heat gain (watts) by this fluid will be given by:

$$Q_{fluid} = \rho \cdot C_p \cdot f \cdot [T_e - T_i] \quad (2)$$

where

- T_i = inlet fluid temperature, °C
- T_e = exit fluid temperatures, °C
- f = fluid volumetric flow rate, m³/sec.
- ρ = fluid density at constant pressure, kg/m³
- C_p = specific heat at constant pressure, J/kg•°C

- 6.2.4.1 *Fluid Temperatures* – The thermocouples used to measure the inlet and outlet temperatures and the temperature difference between them shall be placed in the middle of the fluid stream as close as practical to the insulated chamber wall.
- 6.2.4.1.1 *Temperature Difference* - The temperature difference measuring devices are calibrated for the range of temperatures and temperature differences encountered in the tests. The devices used for measuring the temperature difference shall be, Type T thermopiles, precision resistance thermometers separated or connected in two arms of a bridge circuit, precision thermistors separated or connected in two arms of a bridge circuit, matched type T thermocouples, or other devices shown to be equal or better than those listed above. The temperature sensors shall be capable of measuring temperature differences within ± 0.05 °C (± 0.09 F).
- 6.2.4.2 *Flow Measurements* – The accuracy of the liquid flow rate measurement shall be equal to or better than 1.0% of the measured value in mass units per unit time.

6.2.5 *Automated Systems for Tracking Solar Calorimeter Tilt and Azimuth* – It is advantageous to mount outdoor calorimeter cells in a rotating, and/or gimbaled frame to allow the orientation of the calorimeter to track the sun as it moves through the sky. NFRC 200 requires that the incident angle remain within 5 degrees of normal during the test. This can only be practically achieved by using an automated motorized system that can change the tilt and azimuth of the calorimeter to face the sun as it moves through the sky.

6.3 Solar Radiation Measurement

- 6.3.1 The incident radiant flux shall be measured and recorded on a continuous basis throughout the test period at the minimum time interval specified in Section 7.4.1.1.
- 6.3.1.1 *Radiometer Requirements* – Pyranometers are radiometers used to measure the global short wavelength (solar) radiation incident on the test aperture, and pyrhemometers are radiometers used to measure the direct beam solar irradiance. The characteristics of equipment for the measurement of irradiance are described in ISO 9060 and the World Meteorological Organization Guide to Meteorological Instruments and Methods of Observation. Only ISO 9060 Secondary Standard Instruments (Section 4.3) shall be used. The instruments specified in this procedure shall have the following minimum characteristics.
- 6.3.1.1.1 *Variation with Ambient Temperature* – During the test, the change in the instrument's response due to variations in ambient temperature shall be less than $\pm 2\%$. This characteristic shall be verified using a temperature curve determined for the specific instrument.
- 6.3.1.1.2 *Variation in Spectral Response* – Pyranometers shall have a constant sensitivity to within $\pm 3\%$ over the spectral range from 0.35 to 1.5 micrometers.
- 6.3.1.1.3 *Nonlinearity of Response* – Unless the response of the pyranometer is within $\pm 0.5\%$ of linearity over the range of irradiance existing during the test, the pyranometer shall be used with a calibration curve relating the output to the irradiance with an accuracy of $\pm 0.5\%$.
- 6.3.1.1.4 *Time Constant* – The time constant of the pyranometer, defined as the time required for the instrument to achieve a reading of 63.2% ($I/I_0 = 1 - e^{-t/\tau}$). When $t = \tau$, $I/I_0 = (1 - 1/e) \approx 63.2\%$) of its final reading after a step change in solar irradiance, shall be less than 15 seconds.
- 6.3.1.1.5 *Variation with Angle of Incidence* – Ideally the response of the pyranometer is proportional to the cosine of the incident angle of the direct solar radiation and is constant at all azimuth angles. Unless the pyranometer's deviation from a true cosine response is less than $\pm 10 \text{ W/m}^2$ for the incident angles encountered during the test(s), the pyranometer shall be used with the latest calibration curve relating the response to the angle of incidence to correct for angular errors with accuracy within $\pm 10 \text{ W/m}^2$.
- 6.3.1.1.6 *Variation with Tilt* – Unless the pyranometer response varies less than $\pm 0.5\%$ for tilts ranging from horizontal to the largest tilt encountered during the test(s), the pyranometer shall be used with a calibration curve relating the response to the angle of inclination with an accuracy within $\pm 0.5\%$.

- 6.3.1.1.7 *Effects of Temperature Gradient* – The pyranometer used during the test(s) shall be placed in its test position and allowed to equilibrate for at least 30 minutes before the test commences.
- 6.3.1.1.8 *Calibration* – The pyranometer shall be calibrated for solar response within 12 months preceding the fenestration system test(s) against another pyranometer whose calibration uncertainty relative to recognized measurement standards is known. Any change of more than 1% over a one-year period shall warrant the use of more frequent calibration or replacement of the instrument. If the instrument is damaged in any significant manner, it shall be re-calibrated or replaced. All calibrations shall be performed using ASTM E 824 at normal incidence (Type C), and at a tilt angle of $40^\circ \pm 20^\circ$ from horizontal.
- 6.3.1.2 *Sample Plane Pyranometer* – A pyranometer shall be used to measure the incident irradiance on a plane parallel to the test aperture. It shall have the same minimum operating characteristics as listed above for a pyranometer.
- 6.3.1.3 *Horizontal Pyranometer* – A horizontal pyranometer shall be used to measure the global horizontal (beam plus diffuse) irradiance.

6.4 Measurement of Ambient Conditions

- 6.4.1 The air temperature and wind speed and direction shall be measured and reported for the duration of the test.
- 6.4.1.1 *Exterior Air Temperature Instrumentation* – The ambient air temperature near the solar calorimeter shall be measured in at least one location at a distance not to exceed 2 meters (6 feet) from the solar calorimeter. The ambient air temperature sensors shall be placed in locations that are shaded from direct solar irradiation.
- 6.4.1.2 *Wind Speed and Direction* – The wind speed and direction near the solar calorimeter shall be measured in at least one location at a distance not to exceed 2 meters (6 feet) from the calorimeter (This measurement shall not be required for indoor or enclosed calorimeters).
- 6.4.1.3 *Measured Weather Side Surface Heat Transfer Coefficient* – The surface heat transfer coefficient on the surface parallel with the test specimen shall be measured while the test is in progress using a unique device described in Annex A1. The outdoor surface heat transfer coefficient measured by the Solar-Air Heat Transfer Coefficient Meter shall be used in the calculation of the overall heat flux through the test specimen during the test based on the temperature difference between the inside and the outside, and the Modified Thermal Transmittance (See Section 8.5.1.2).
- 6.4.1.4 *Barometric Pressure* – The barometric pressure near the solar calorimeter shall be measured, and recorded.

7. Test Procedure

7.1 Test Methodology

7.1.1 The Solar Heat Gain Coefficient of the fenestration system shall be determined from the measured values of: [1] the net rate of energy absorption in the calorimeter chamber enclosure, which is presumed equal to the total heat inputs less heat extracted or lost by the system, [2] the incident solar irradiance, [3] the ambient and enclosure temperature differences, and [4] the U-factors of the fenestration system and of the calorimeter walls.

7.1.1.1 The net rate of energy absorption in the calorimeter enclosure (equivalent to the net rate of energy admitted by the fenestration system) is the sum of the storage in the cell, the energy extracted by the heat extraction system, the heat transfer through the calorimeter walls, the heat transfer through the surround panel, and the electrical power inputs. The net heat measured by the calorimeter heat extraction systems is:

$$Q_{net} = SHGC \cdot A_s \cdot E_S - U_s \cdot A_s \cdot \Delta T_s + Q_{env} \quad (3)$$

where :

- Q_{net} = Energy Extracted by Heat Extraction System, W
- $SHGC$ = Solar Heat Gain Coefficient
- A_s = Area of the Test Specimen, m²
- E_S = Solar Irradiance, W/m²
- ΔT_s = Air Temperature Difference across Test Specimen, °C
- U_s = U-factor of the Test Specimen, W/(m²•K)
- Q_{env} = Total Energy Transmitted through Calorimeter Walls, Surround Panel, and Electrical Input from Fans or Pumps, W

Solving for SHGC yields:

$$SHGC = \frac{Q_{net} - U_s \cdot A_s \cdot \Delta T_s - Q_{env}}{A_s \cdot E_S} \quad (4)$$

NOTE 6: In general, by minimizing the temperature difference between the interior air of the calorimeter, and the exterior of the calorimeter shell, and by shielding the calorimeter exterior from external radiation, we reduce the term $U_s A_s \Delta T_s$, and can directly calculate SHGC from $(Q_{net} - Q_{env})/A_s E_S$. Alternatively, (if the calorimeter is not designed to control ΔT to 0) we can calculate $(Q_{net} - Q_{env})/A_s E_S$ for a number of ΔT . A plot of $(Q_{net} - Q_{env})/A_s E_S$ vs $\Delta T/E_S$ will give the SHGC (y-intercept) and the fenestration U-factor (slope).

7.2 Test Specimen Installation

7.2.1 *Test Specimen Preparation* – Before the test specimen is installed in the calorimeter, the laboratory shall inspect the fenestration product for damage and compare the dimensions of the product to the working drawings supplied by the manufacturer. The test laboratory

shall also measure the glazing deflection of all the insulated glass units in the fenestration product using the procedure outlined in ASTM E 1423. The glazing deflection(s) and any discrepancies between the test specimen and the working drawings shall be recorded and reported in the test report.

7.2.2 *Test Specimen Installation* – Test specimens shall be installed in surround panels that have been previously characterized using the calibration test procedures specified in Section 5. Surround panels shall be constructed and instrumented as specified in Annex A6. The test specimen shall be mounted in the surround panel as it is intended to be installed in actual end use. That is, the complete assembly including all frame elements shall be in place during the test. The outside surface of the test specimen frame shall be flush with the outside surface of the surround panel in the calorimeter. The test specimen, and any cracks or holes in the product shall be sealed for air infiltration to the specifications in Section 7.2.3 using tape or caulk.

7.2.3 *Test Specimen Air Leakage* – All potential air leakage sites on the test specimen, and at the interface between the surround panel and the test specimen, shall be sealed with tape and/or caulking as close to the primary seal as possible to minimize or eliminate air leakage between the interior of the solar calorimeter and ambient air. The tape and/or caulking shall have a similar surface emittance (± 0.1), and solar absorptance (± 0.1) as the test specimen or surround panel surface to which it is attached. If metal tape is used, the outer surface shall be painted or covered with tape so that the surface emittance, and solar absorptance is similar to (± 0.1) the surface to which it is attached. The method and placement of the air seal can affect the thermal performance of the test specimen. Therefore, the test specimen shall be sealed at the exterior side of the surround panel with tape, caulking or other material of similar surface emittance and solar absorptance to that of the adhering surface. If the surround panel is assembled from different pieces of the same material, the joints between surround panel pieces shall be sealed on both sides of the surround panel. In no case shall the tape or caulk cover more than 50 mm (2 in.) of each surround panel edge.

NOTE 7: As an additional precaution to minimize the potential for leakage of air through and around the sealed test specimen, means may be provided to measure and equalize the pressure difference across the test specimen. See Section 7.1.3 of ASTM E 1423 for additional information on how to equalize the pressure difference across the test specimen.

7.2.4 *Test Specimen Instrumentation* – Since the surface temperature of the test specimen is not used in calculating the measured Solar Heat Gain Coefficient of the test specimen, there is no requirement to place temperature sensors on the specimen. At a minimum, many laboratories attempt to measure and report the center-of-glazing temperatures on both sides of the glazing unit or the fenestration attachment, but surface temperatures of transparent objects in direct sunlight can be difficult to accurately measure. Since some laboratories may report glazing or whole product surface temperatures measured during the test, guidance is given as to how to consistently apply and measure surface temperatures of test specimens in solar calorimeters.

- 7.2.5 To determine the average surface temperature of the test specimen, it is necessary to make temperature measurements on both sides of the test specimen frame, glazing (center and near edges) and on any other surfaces (sills, muntins, etc.) in order to provide a representative area weighted value of the surface temperatures of the specimen. It must be recognized that there is such a wide range of fenestration system designs that it is not possible to specify the locations of the temperature sensors to provide a correct area weighted determination of the various surface temperatures for all configurations. See NFRC 100 or ASTM E 1423 for additional guidance on the location of test specimen surface temperature sensors for different fenestration systems. The weighted heat transfer surface areas used with the frame/sash temperature measurements shall add up to the total surface area of the frame/sash in contact with the surrounding air.

All surface temperature-measurements shall be made using the temperature sensor attachment techniques and area weighing criteria specified in Section 6.5.3 of ASTM C 1199. The test specimen surface temperature sensor wires shall be led in such a way as to minimize the disturbance to the air flow and solar radiation incident on the test specimen.

- 7.2.5.1 When attaching temperature sensors (i.e., thermocouples) to frame and sash surfaces, the emittance and solar absorptance of the tape or glue shall be similar (± 0.1) to the emittance and solar absorptance of the surface to which it is attached.
- 7.2.5.2 When attaching temperature sensors to glazing, the emittance of the tape or glue shall be similar to (± 0.1) the emittance of the glazing surface to which it is attached, and be visually transparent. The tape or glue used to attach temperature sensors to glazing shall not be more than 12 mm (0.5 in.) wide, but be at least 100mm (4 in.) long.

NOTE 8: Accurately measuring the temperature differential across insulating glazing units can be very difficult due to the impact of absorbed solar radiation on the measurement device. The best method is to use temperature measurement devices that are as small as possible. Some test operators report success with using 30-gauge thermocouple wire with 100 mm (4 in.) of insulation removed from the measurement junction, and then secured to the glazing with "Sunshine Glue" (clear cement that cures with UV light or sunshine).

- 7.2.6 *Test Specimen Thermal Transmittance* – The U-factor for the test specimen shall be determined using ASTM C 1199, or NFRC 100.

7.3 Test Conditions

- 7.3.1 *General* – Wherever the incident solar irradiation conditions, temperatures, and standard heat transfer coefficients are not otherwise specified, ASTM E 1423 or NFRC 200 shall be used as a guide for selecting the appropriate test conditions.
- 7.3.2 *Incident Solar Irradiation* – Two pyranometers, one mounted in the test sample plane, and the other mounted horizontally, shall be used to measure the incident global solar irradiance during the test. The irradiance measured during each test shall not vary from the average value by more than 5%. The incident irradiance shall be uniform over the surface of the test specimen for the duration of the test.

- 7.3.2.1 *Incident Angle Tolerance* – The SHGC of glazing systems and fenestration shading systems will vary with the incident angle of the source of irradiation. For this reason, fenestration rating systems, such as NFRC or CSA, often specify a range or tolerance for the incident angle for the duration of the test measurement period. This is not an issue for solar calorimeters located indoors, which are illuminated by a fixed artificial light source, but solar calorimeters located outdoors usually need a tracking mechanism to change the orientation and tilt of the solar calorimeter to follow the sun as it moves across the sky.
- 7.3.2.2 *Indoor Light Source (Artificial Sunlight)* – The incident spectral distribution of an artificial light source used for indoor solar calorimeters shall be measured normal to the test specimen plane. The shape of the incident spectral irradiance shall not depart from the standard solar spectral distribution at an air mass of 1.5 specified in ASTM E 1585 or NFRC 300 by more than 10% at any wavelength, with the exception of narrow spectral lines where the total energy from all spectral lines is less than 5% of the total radiant flux.
- 7.3.2.3 The shape of each spectrum shall be determined by normalizing each to its value at the wavelength of peak spectral irradiance.
- 7.3.2.4 The comparison of shapes shall be made on a wavelength-by-wavelength basis. When the source spectrum has no value at a wavelength in the standard spectrum, a value at that wavelength shall be calculated by linear interpolation.
- 7.3.3 *Ambient Temperature* – The ambient temperature outside of the solar calorimeter shall be recorded, and shall not vary more than ± 5.0 °C (± 9.0 °F) over the duration of a test.
- 7.3.3.1 *Indoor Solar Calorimeter Ambient Temperature* – Solar calorimeters located indoors shall maintain an exterior air temperature within ± 1.0 °C (± 1.8 °F) of the set point over the duration of a test.
- 7.3.4 *Exterior Wind Conditions* – The wind speed and direction shall be measured at a location not to exceed 2 meters (6 feet) from the solar calorimeter.
- 7.3.4.1 *Indoor Solar Calorimeter Exterior Wind Conditions* – Solar calorimeters located indoors need external fans to provide a minimum air flow on the outside of the test specimen and surround panel during test periods. The airflow shall be directed either perpendicular or parallel to the plane of the test specimen in such a way that the velocity is uniform over the surface of the test specimen when measured at a distance of 100 mm (4 in.) from the surround panel. In the absence of other standards, the air velocity shall be 3.4 ± 0.1 m/s (7.5 ± 0.2 mph).
- 7.3.4.2 *Outdoor Solar Calorimeter Exterior Wind Conditions* – Solar calorimeters located outdoors shall measure the weather side surface heat transfer coefficient during the test using the Solar-Air Heat Transfer Coefficient Meter described in Annex A1. The Solar-Air Heat Transfer Coefficient Meter shall not be used if the incident angle of the sun is greater than 60° from normal to the surface.
- 7.3.5 *Interior Conditions Inside Solar Calorimeter* – There shall be no more than 2.0 °C (3.8 °F) of temperature stratification per meter from top to bottom of the interior height of the solar calorimeter measured along the plane parallel to the surround panel, and at a distance of 75 mm (3 in.) from the surround panel surface. Small fans may be placed inside the chamber in order to induce mixing and a uniform air flow across the test specimen. The air flow inside the calorimeter shall be less than 0.3 m/s (0.7 mph) when measured 75 mm (3 in.) from the inside surface of the surround panel.

- 7.3.6 *Fluid Flow Heat Extraction and Control* – The air temperature within the calorimeter is controlled through the combined use of a heat exchanger and fluid circulation loop. The heat exchanger functions to remove a metered quantity of heat in order to maintain the interior cell air and surface temperatures at the desired state. In the case of a liquid circulation loop, this is accomplished by controlling fluid inlet temperature and flow rate.
- 7.3.6.1 The fluid flow rate shall remain within $\pm 5.0\%$ of the average flow rate for the duration of the test.
- 7.3.6.2 The inlet fluid temperature shall remain within $\pm 1.0^{\circ}\text{C}$ ($\pm 1.8^{\circ}\text{F}$) of the average inlet fluid temperature for the duration of the test.
- 7.3.7 The instantaneous Solar Heat Gain Coefficient shall be calculated at each measurement interval.
- 7.3.7.1 For tests performed at a constant incident angle (i.e., NFRC 200) The Solar Heat Gain Coefficient shall not vary more than 2% for the duration of the test.

7.4 Determination of Steady-State Conditions

- 7.4.1 Establish steady-state solar irradiance, temperature and power conditions for which the test specimen is to be tested and record measurements of solar irradiance, temperatures, power, flow rate, wind velocity and direction. Steady-state is achieved when the test conditions specified in Section 7.3 have been met for a period of 5 continuous time constants of the calorimeter, surround panel and test specimen. The time constant of the solar calorimeter and surround panel can be determined using the procedure specified in Section A.5. The measured SHGC shall not change monotonically during the test period.
- 7.4.1.1 Measurements of solar irradiance, temperatures, power, flow rate, wind velocity and direction shall be recorded at a minimum of 1 minute intervals.

8. Calculation Procedure

8.1 General Description of Calculation Procedure

8.1.1 Solar calorimetry relies on thermal measurements made on the inside and outside of the shell of a calorimeter cell (control boundary), which includes the test specimen, calorimeter enclosure, and associated equipment for measurement and control of the interior and exterior climatic conditions. Taking into account all the measurements specified in Sections 5 and 6, the heat flux through the test specimen, Q_S , shall be determined by the following equation:

$$Q_S = Q_{Walls} + Q_{SP} + Q_{fl} + Q_{fluid} + Q_{AUX} \quad (5)$$

where :

- Q_S = Heat flux through test specimen, W
- Q_{Walls} = Heat flux through solar calorimeter walls, W
- Q_{SP} = Heat flux through surround panel, W
- Q_{fl} = Heat flux by flanking loss as determined in Section 5.2.2.1, W
- Q_{fluid} = Heat removed by fluid heat extraction system, W
- Q_{AUX} = Heat input into solar calorimeter by pumps and fans, W

8.1.2 The SHGC, which is the ratio of the incident irradiation to the heat gain through the test specimen shall be calculated using the following equation:

$$SHGC = \frac{Q_S - Q_{U-Factor}}{A_S \cdot E_S} \quad (6)$$

where :

- $SHGC$ = Solar Heat Gain Coefficient of test specimen, dimensionless
- $Q_{U-Factor}$ = Heat flux due to air temperature difference (Thermal Transmittance) of test specimen, $W/(m^2 \cdot ^\circ K)$
- A_S = Projected area of test specimen, m^2
- E_S = Solar irradiation incident on the test specimen, W/m^2

8.2 Heat Transfer through Solar Calorimeter Shell

8.2.1 *Solar Calorimeter Walls, Q_{Walls}* – The heat flow through the solar calorimeter walls is a function of the measured temperature difference on both sides of the solar calorimeter walls as described in Sections 6.2.2.5. The temperature difference measurement is multiplied by the conductance-area coefficient of the wall, UA_{Wall} , as determined by Section 5.2.1.1. The heat flow through the solar calorimeter walls shall be determined by the following equation:

$$Q_{Walls} = UA_{Walls} \cdot \Delta T_{Walls} \quad (7a)$$

or

$$Q_{Walls} = UA_{Walls} \cdot E.M.F._{walls} \quad (7b)$$

where

- UA_{Walls} = Conductance-Area of Solar Calorimeter Walls, $W/^\circ K$ or $W/E.M.F.$
- T_{Walls} = Temperature Difference across Solar Calorimeter Walls, $^\circ K$

$E.M.F._{walls}$ = Output from Thermopile Measuring the Temperature
Difference across Solar Calorimeter Walls, °K

8.2.2 *Surround Panel, Q_{SP}* – The heat flow through the surround panel is a function of the measured temperature difference on both sides of the surround panel as described in Section 6.2.3. It is also a function of both the thermal conductance of the surround panel, C_{SP} , as determined using the methods specified in Section 5.2.1.2, and the projected area of the face of the surround panel, A_{SP} , as measured by the testing laboratory. The heat flow through the surround panel shall be determined by the following equation:

$$Q_{SP} = C_{SP} \cdot A_{SP} \cdot (t_{SPh} - t_{SPc}) \quad (8)$$

where

- C_{SP} = Conductance of Surround Panel, W/(m² • °K)
- A_{SP} = Area of Surround Panel, m²
- t_{SPh} = Temperature of Interior Surface of Surround Panel, °K
- t_{SPc} = Temperature of Exterior Surface of Surround Panel, °K

8.2.3 *Flanking Loss, Q_{fl}* – The flanking loss heat flow through the surround panel is a function of the surround panel thickness and construction, and is determined using the process described in Section Annex A3. The flanking loss heat flow may also be a function of the air temperature or velocity inside or outside of the solar calorimeter, or the surface temperatures of the surround panel, and should be adjusted for such based on previous calibration measurements.

8.3 Heat Removal by Fluid Heat Extraction System

8.3.1 *Fluid Heat Extraction System, Q_{fluid}* – The absorber plate inside of the solar calorimeter contains a fluid heat extraction system that removes much of the heat absorbed by the solar calorimeter. The heat extracted by the fluid heat extraction system is a function of the properties of the fluid, ΔT , and C_p , the volumetric flow rate of the fluid, f , and the inlet and exit fluid temperature difference, $(t_e - t_i)$. Equation 8 in Section 6.2.4 shall be used to determine the heat extracted by the fluid heat extraction system:

$$Q_{fluid} = \rho \cdot C_p \cdot f \cdot (t_e - t_i) \quad (9)$$

where

- ρ = Fluid density at constant pressure, Kg/m³
- C_p = Specific heat at constant pressure, (Wh)/(Kg•°K)
- f = Fluid volumetric flow rate, Kg/h
- t_e = Exit fluid temperature, °K
- t_i = Inlet fluid temperature, °K

8.4 Heat Input by Fans and Pumps

8.4.1 *Heat Input by Fans and Pumps, Q_{AUX}* – There may be pumps or fans located inside the solar calorimeter to help minimize the temperature gradients in the air and on the absorber plate. Also, some instrumentation (i.e., hot wire anemometers) can be a source of heat input. All the power used by these auxiliary devices located inside of the solar calorimeter shall be measured and recorded for the duration of the test. Typically, this is best performed by solid-state linear integrators, but the integration of frequent

measurements of the voltage and amperage used by these auxiliary devices can alternatively be used.

8.5 Heat Transfer Through the Test Specimen

8.5.1 *Heat Flow Through Test Specimen, $Q_{U-factor}$* – There are two methods used to calculate the heat transfer through the test specimen due to the air temperature difference across the test specimen. One method uses the standardized thermal transmittance as determined by ASTM C 1199, NFRC 100, or the results from regression analysis of the measurements from this test. This method is more appropriate for use in indoor solar calorimeters, where the exterior surface heat transfer coefficient can be held relatively constant at a value close to the standardized surface heat transfer coefficient. The other uses the modified thermal transmittance as determined by ASTM C 1199, or NFRC 100. This method is best for solar calorimeters that are located outdoors, and are subjected to variable exterior wind conditions. Although either method is permitted, the test report shall identify which method was used to calculate the reported SHGC values.

8.5.1.1 *Standardized Thermal Transmittance, U_{ST}* – The Standardized Thermal Transmittance can be used to calculate the heat transfer through the test specimen due to the air temperature gradient across the test specimen. ASTM C 1199 or NFRC 100 shall be used to determine the Standardized Thermal Transmittance, U_{ST} , of the test specimen except as noted in Section 8.5.1.2. The Standardized Thermal Transmittance shall be multiplied by the projected area of the test specimen, A_S , and the air temperature difference, $(t_h - t_c)$, across the test specimen using the following equation:

$$Q_{U-factor} = U_{ST} \cdot A_S \cdot (t_h - t_c) \quad (10)$$

where U_{ST} = Standardized Thermal Transmittance of test specimen, W/(m² • °K)

A_S = Projected area of test specimen, m²

t_h = Air temperature inside solar calorimeter, °K

t_c = Air temperature outside solar calorimeter, °K

This method is more appropriate for use in indoor solar calorimeters, where the exterior wind velocity and direction can be controlled. The wind velocity shall be held at a value that produces an exterior surface heat transfer coefficient, h_c , that is within ±10.0% of the standardized weather side surface heat transfer coefficient, h_{STc} , listed in Section 6.2.2 of ASTM E 1423.

8.5.1.2 *Modified Thermal Transmittance, U_M* – In solar calorimeters located outdoors, the heat transfer due to the temperature difference across the test specimen shall be determined in way that accounts for the variations in the exterior surface heat transfer coefficient that occur with the changes in outside wind speed and direction. The Standardized Thermal Transmittance, U_{ST} , (ASTM C 1199 or NFRC 100) shall be modified by removing the standardized weather side surface heat transfer coefficient, h_{STc} , (See Section 6.2.2 of ASTM E 1423). The *Modified Thermal Transmittance*, U_M , which is the thermal transmittance of the test specimen in the absence of the exterior surface heat transfer coefficient, shall be calculated using the following equation:

$$U_M = \frac{1}{\frac{1}{U_{ST}} + \frac{1}{h_{STc}}} \quad (11)$$

where U_M = Modified Thermal Transmittance of test specimen, W/(m² • °K)
 h_{STc} = Weather side surface heat transfer coefficient, W/(m² • °K)

8.5.1.2.1 *Measured Weather Side Surface Heat Transfer Coefficient, h_{h-sun}* – The Modified Thermal Transmittance shall be used to determine the total thermal transmittance of the test specimen during the test once the exterior surface heat transfer coefficient, h_{h-sun} , as measured on the Solar-Air Heat Transfer Coefficient Meter, is known. The Solar-Air Heat Transfer Coefficient Meter is described in greater detail in Annex A1. In essence, the Solar-Air Heat Transfer Coefficient Meter measures the surface temperature of a metal surface painted black, which is in the same plane and with a similar exposure to sunlight and wind as the test specimen. The temperature of the black plate shall be used to calculate the exterior surface heat transfer coefficient using the following equation:

$$h_{h-sun} = \frac{E_S \cdot \alpha_{plate}}{t_{plate} - t_c} \quad (12)$$

where h_{h-sun} = Measured weather side surface heat transfer coefficient, W/(m² • °K)
 α_{plate} = Solar absorptance of Solar-Air Heat Transfer Coefficient Meter
 t_{plate} = Temperature of Solar-Air Heat Transfer Coefficient Meter, °C
 E_S = Solar irradiation incident on specimen, W/(m²)

8.5.1.2.2 *Total Measured Thermal Transmittance* – The exterior surface heat transfer coefficient, h_{h-sun} , as measured by the Solar-Air Heat Transfer Coefficient Meter shall be combined with the Modified Thermal Transmittance, U_M , to determine the Standardized Thermal Transmittance using the following equation:

$$U_{ST} = \frac{1}{\frac{1}{h_{h-sun}} + \frac{1}{U_M}} \quad (13)$$

8.6 Solar Irradiation Incident on the Test Specimen

8.6.1 *Solar Irradiation Incident on the Test Specimen, E_S* – A pyranometer shall be mounted in the same plane and with the same exposure to sunlight as the test specimen to measure the solar irradiation incident on the test specimen. The output from the pyranometer shall be multiplied by its calibration constant to determine the solar energy incident on the test specimen using the following equation:

$$E_S = V_{PSP} \cdot P_{PSP} \quad (14)$$

where V_{PSP} = Millivolt output from pyranometer, mV
 P_{PSP} = Pyranometer calibration constant, W/(m²•mV)

NOTE 9: The pyranometer calibration constant is one of the most important calibrations that need to be properly and frequently performed in order to accurately calculate SHGC values. Previous comparisons of solar calorimeter results from different laboratories have shown that the measurement of incident solar irradiation has a strong influence on the final SHGC results. In addition, the calibration constant for some PSP type pyranometers has been shown to change over time. For these reasons, the pyranometers used for calculating the SHGC must be frequently calibrated at a reputable laboratory (a minimum of one time per year).

8.7 Calculation of Solar Heat Gain Coefficient

- 8.7.1 *Data Collection and Analysis* – Unlike most ASTM thermal transmittance or conductance tests in which the temperatures and heat flows eventually become constant, an outdoor solar calorimeter is unlikely to be at steady-state conditions for a long period of time. For this reason, the raw data gathered from solar calorimeters is not averaged before it is analyzed. Instead, the heat balance and SHGC are calculated for each measurement interval, and the SHGC results are usually plotted in respect to the incident angle or the profile angle of the incident sunlight. If the measured SHGC does not drastically vary over a period of the test as in a solar calorimeter that tracks the sun to maintain a constant incident angle, then those SHGC results may be averaged over the period in question. Nevertheless, the SHGC is calculated from each set of instantaneous raw data collected before it is averaged.
- 8.7.1.1 *Heat Balance Equation, Q_s* – Once the required variables are measured, the heat balance for the solar calorimeter shell shall be determined using Equation 11 in Section 8.1.1.
- 8.7.1.2 *Calculation of Solar Heat Gain Coefficient, SHGC* – Once the heat balance equation is solved, the SHGC for the test specimen shall be determined using Equation 12 in Section 8.1.2, and plotted in relation to the incident angle or profile angle of the incident solar irradiation.

9. Test Report

9.1 Reported Data

- 9.1.1 Report the following information, where applicable, for the period in which the solar calorimeter is in steady-state conditions as defined by Section 7.4:
- 9.1.1.1 The test specimen size, design drawing(s) and a detailed description of all the test specimen components (i.e., frame, glazing, hardware weather-stripping, etc.) shall be reported. Any non-standard test specimen size and non-standard test conditions used shall be explained.
- 9.1.1.2 Description of surround panel, and installation of test specimen.
- 9.1.1.3 Date and the Local Time of the beginning and end of the test period.
- 9.1.1.4 Description of the location of the solar calorimeter(s); and the foreground in view of the test specimen
- 9.1.1.5 Previous date of each calibration test specified in Section 5; including the wall heat flux calibration test, surround panel flanking loss calibration test, calibration transfer standard test, fluid flow rate instrumentation, pyranometer, and fluid temperature difference instrumentation.
- 9.1.1.6 The average Solar Heat Gain Coefficient, SHGC, over a constant incident or profile angle; and the average incident angle, θ_E , or average profile angle, ψ_E , of the incident solar irradiation (i.e., SHGC of 0.56 at a profile angle of 30°).
- 9.1.1.7 A graph of the measured Solar Heat Gain Coefficient, SHGC in relation to the incident angle, θ_E , or profile angle, ψ_E , of the incident solar irradiation.
- 9.1.1.8 Range of solar calorimeter tilt and azimuth for the duration of the test; if the solar calorimeter moves over the duration of the test, describe the tracking system and strategy.
- 9.1.1.9 Average ambient barometric pressure.
- 9.1.1.10 Average and extremes of exterior wind velocity and direction; and average and range of exterior surface heat transfer coefficient, h_{h-sun} , during the test
- 9.1.1.11 Diagrams documenting all surface temperature locations (i.e., absorber plate, surround panel, etc.), and corresponding temperatures at each location at the time of greatest solar irradiation. If the test specimen surface temperatures are measured, include the average surface temperature of the test specimen on the weather side, t_2 , and calorimeter side, t_1 .
- 9.1.1.12 Diagrams documenting all air temperature locations (i.e., inside, t_h , and outside, t_c , of solar calorimeter), and corresponding temperatures at each location at the time of greatest solar irradiation.
- 9.1.1.13 The average interior air temperature, t_c , and exterior air temperature, t_h , measured during the test.
- 9.1.1.14 Inlet fluid temperature, outlet fluid temperature, flow rate of the fluid, f , and heat extracted by the fluid heat extraction system, Q_{fluid} , measured at the time of greatest solar irradiation.
- 9.1.1.15 Temperature difference across solar calorimeter walls, and the heat flow associated with that temperature difference, Q_{walls} , at the time of maximum solar irradiation.
- 9.1.1.16 The average standardized thermal transmittance, Us ; a description of the method used to determine the average standardized thermal transmittance; including the heat flow due to thermal transmittance effects, $Q_{U-Factor}$, at the time of maximum solar irradiation.

- 9.1.1.17 The temperature of the interior surface, t_{sp1} , and the exterior surface of the surround panel, t_{sp2} , measured at the time of maximum solar irradiation; including the heat flow through the surround panel, Q_{sp} .
- 9.1.1.18 The heat added to the interior of the solar calorimeter by heaters, fans or pumps, Q_{AUX} , at the time of maximum solar irradiation.
- 9.1.1.19 The calculated heat flow through the test specimen, Q_S , measured that the time of maximum solar irradiation.
- 9.1.1.20 The maximum, minimum and average solar irradiation, E_S , measured over the duration of the test.
- 9.1.1.21 The procedures used to estimate the uncertainties shall also be documented as an Annex to the report.
- 9.1.1.22 The following statement from NOTE 2 shall be included in the test report directly after the above results are reported. “This test method does not include separate procedures to determine the heat flows due to either air movement or nighttime U-factor effects. As a consequence, the SHGC results obtained do not reflect the overall performance which may be found in field installations due to temperature differences, wind, shading, air leakage effects, and the thermal bridge effects specific to the design and construction of the fenestration system opening. Since there are a wide variety of fenestration system openings in residential, commercial and industrial buildings, it is not feasible to select a “typical” surround panel construction in which to mount the fenestration test specimen. The selection of a relatively high thermal resistance surround panel places the focus of the test on the thermal performance of the fenestration system alone. Therefore, it should be recognized that the thermal transmittance results obtained from this test method, for ideal laboratory conditions in a highly insulating surround panel, should only be used for fenestration product comparisons or as input to thermal performance analyses which also include thermal, air leakage and thermal bridge effects due to the surrounding building structure. To determine air leakage effects for windows and doors, refer to ASTM E 283. For thermal transmittance refer to ASTM C 1199.”

9.2 Uncertainty Estimation

- 9.2.1 The individual laboratory measurement uncertainty of this test method depends upon the test equipment and operating procedures, and upon the test conditions and specimen properties. For this reason no simple quantitative statement can be made that will apply to all tests; however, in order to comply with the requirements of Section 9.1.1.21, it is necessary to estimate the uncertainty of the results for each test to be reported. Such estimates of uncertainty can be based upon an analysis using the propagation of errors theory (often called uncertainty analysis) discussed in textbooks on engineering experimentation and statistical analysis¹⁴. These uncertainty estimates can be augmented by the results of interlaboratory test comparisons, by the results of experiments designed to determine repeatability of the effect of deviations from design test conditions, and by

¹⁴ Schenck, H., *Theory of Engineering Experimentation*, McGraw Hill, New York, N.Y., Third Edition, 1979, Chapter 3, p. 53.

measurements of reference specimens from appropriate standards laboratories. In general, the best overall accuracy will be obtained in an apparatus with low solar calorimeter wall heat transfer, low surround panel heat transfer, and low flanking (surround panel and surround panel frame) heat transfer relative to the test specimen heat transfer. Low solar calorimeter wall heat transfer can be achieved by using highly insulated walls subjected to small temperature differences. Low surround panel heat transfer can be achieved with highly insulated surround panels that have a small exposed surface area in relation to the metering chamber aperture area. Low surround panel and surround panel frame flanking heat transfer, in relation to metering box heat input, can be achieved by using homogeneous and highly insulated surround panels and surround panel frames with no thermal bridges. Also in general, for a particular apparatus, the uncertainty will decrease as the heat transfer through the specimen increases.

10. Precision and Bias

- 10.1 There is no Precision and Bias Statement for this procedure until round robin comparisons can be conducted.

11. Keywords

- 11.1 calorimeter; doors; fenestration; heat; hot box; solar; SHGC; solar calorimeter; skylights; U-factor; windows

ANNEXES
(Mandatory Information)

A1. Solar-Air Heat Transfer Coefficient Meter

A1.1 Description of Solar-Air Heat Transfer Coefficient Meter

A.1.1.1 The exterior surface heat transfer coefficient of the test specimen can be measured during the test using the Solar-Air Heat Transfer Coefficient Meter, which is described in this annex. By measuring the surface temperature of an insulated black metal plate, t_{plate} , exposed to the same sunlight, ambient air flow and temperature as the face of the solar calorimeter, the exterior surface heat transfer coefficient of the test specimen, h_{h-sun} , is estimated at the time of measurement. The use of the measured temperature from this device to calculate the instantaneous SHGC is described in Section 8.5.1.2.1. Although the use of this device is optional, it must be constructed to the specifications in this annex if it is to be used. This device cannot be used if the incident angle of the sun is greater than 60° from normal to the front surface.

A1.2 Construction and Installation of Solar-Air Heat Transfer Coefficient Meter

A.1.2.1 General Description – A thermocouple is attached to the back side of a thin, square aluminum or copper plate measuring 150 ± 50 mm (6.0 ± 2.0 inches) by 150 ± 50 mm (6.0 ± 2.0 inches). That plate is painted black on one side and adhered to a piece of 100 ± 12 mm (4.0 ± 0.5 inches) thick polystyrene foam of the same dimensions (See Fig. A1.1). The apparatus is then mounted on the top of the solar calorimeter so that the black metal plate is in the same plane as the face of the solar calorimeter.

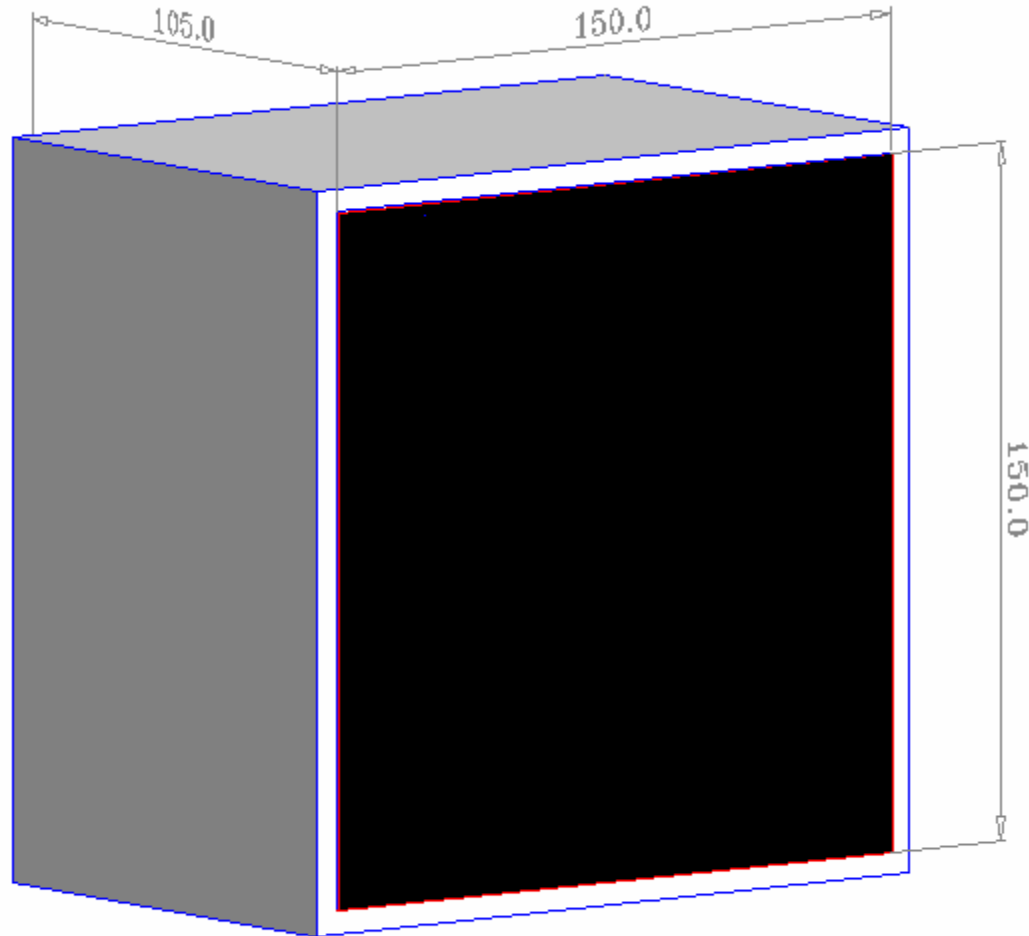


Figure A1.1 – Solar-Air Heat Transfer Coefficient Meter

- A.1.2.1.1 Metal Plate and Instrumentation – Prepare and clean a 1.0 ± 0.25 mm (0.04 ± 0.01 inches) thick copper or aluminum plate measuring 150 ± 50 mm (6.0 ± 2.0 inches) by 150 ± 50 mm (6.0 ± 2.0 inches). The plate must be square. Paint one side flat black so that the solar absorptance is 0.95 ± 0.05 and the emittance is 0.9 ± 0.1 . An initial application of metal primer covered with multiple coats of black paint is recommended. It is also recommended to paint the surface after the thermocouple has been attached to the back of the metal plate as described in Sections A.1.2.1.1.1 or A.1.2.1.1.2.
- A.1.2.1.1.1 *Aluminum Plate* - If the plate is made from aluminum, the back side must be prepared for the attachment of the thermocouple. The bare metal of the thermocouple wire cannot be in electrical contact with the aluminum plate, but must be in good thermal contact with the surface. Therefore, the aluminum must be painted with a thin, hard

coating at the location where the bare thermocouple wire is to be in contact (clear nail polish or liquid insulation paint has been used with success for this purpose). The 30 gage thermocouple shall be prepared by stripping at least 38 mm (1.5 inch) of the wire bare before making the junction (bead). Configure the bare wire into a flat circle about 25 mm (1 inch) in diameter. Once the insulation coating on the aluminum plate has cured, the bare thermocouple wire is adhered to the aluminum plate so that the bead is centered on the back face of the plate (See Fig. A1.2). In addition, glue at least 75 mm (3.0 inches) of the insulated wire to the metal plate (initially adhering the wire to the surface with dots of superglue, and then coating the entire thermocouple wire with a thin layer of high-conductance epoxy has been shown to work for this application).

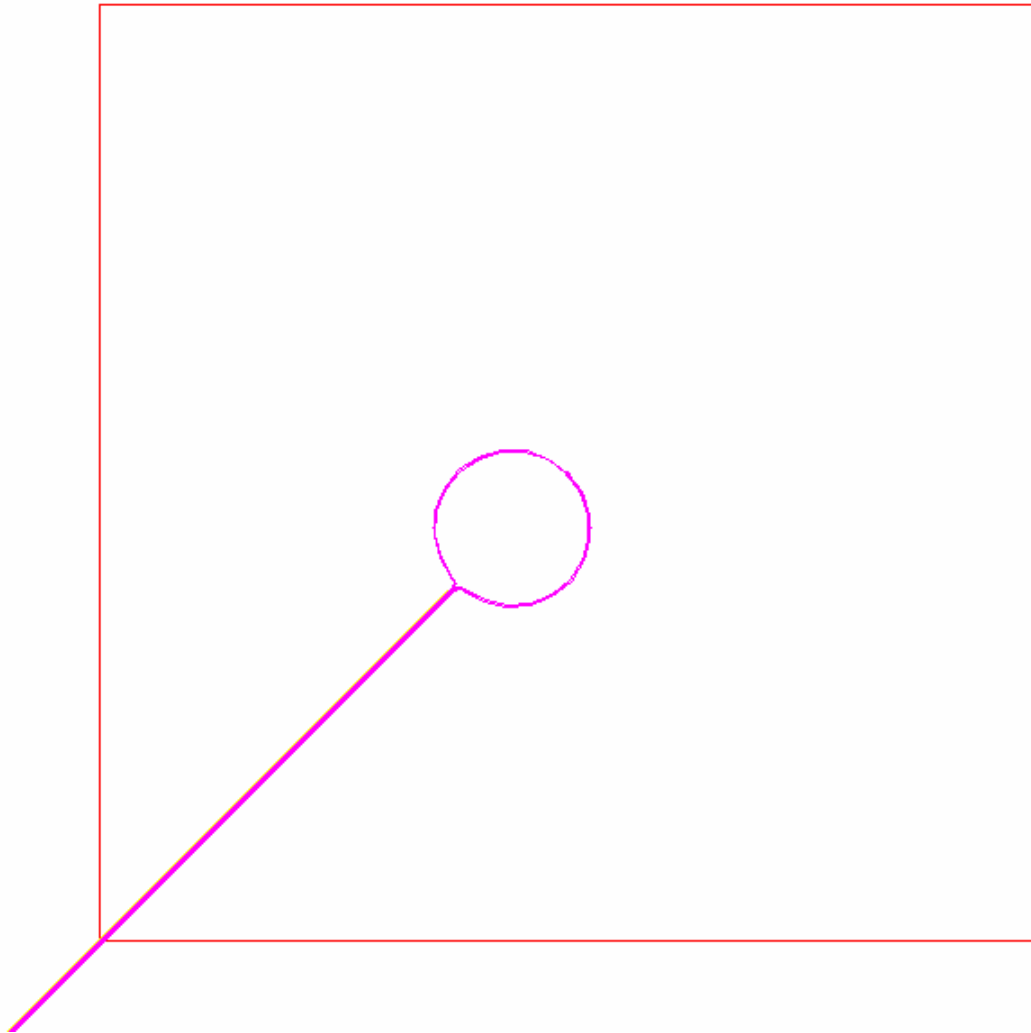


Figure A1.2 – Thermocouple attached to back side of aluminum plate

A.1.2.1.1.2 *Copper Plate* – The thermocouple wire can be attached to a copper plate as described in the previous Section A.1.2.1.1.1, but it can also be directly soldered to the copper

plate. Clean an area about 50 mm (2.0 inch) in diameter in the center of the copper plate with etching fluid or flux. Prepare Type T thermocouple wire (copper-constantan) by stripping 12 mm (0.5 inch) of insulation off both leads. Solder both of the bare leads of thermocouple wire to the copper plate so that the constantan wire is centered in the middle of the back face of the plate. The copper wire shall be soldered so that it is at least 12 mm (0.5 inch) from the location where the constantan wire is attached. Glue at least 75 mm (3.0 inches) of the insulated wire to the metal plate.

A.1.2.1.2 Foam Insulation – The black metal plate is attached to foam insulation so that the thermocouple is located between the plate and the foam. The foam insulation must have a thermal conductivity at 24 °C not in excess of 0.04 W/(m • K) and having a very low gas permeance. The foam shall have the same dimensions as the black metal plate, but shall be at least 100 mm (4.0 inches) thick. The metal plate can be adhered to the foam using water-based contact cement or other adhesive that will not damage the foam. The remaining exposed edges of the foam should be protected against weather by painting or covering with a thin-walled five-sided box made from plywood or plastic that has a solar absorption less than 0.2 on the exposed surfaces. Again, insure that the paint or covering does not damage the foam.

A.1.2.1.3 Installation – The assembled metal plate, thermocouple and foam shall be mounted on top of the calorimeter in such a way so that the face of the black metal plate is in the same plane as the face of the solar calorimeter. The metal plate shall be centered over the test specimen, and there should be no obstructions of the air flow up the test specimen, across the surround panel, and the Solar-Air Heat Transfer Coefficient Meter. The thermocouple shall be connected to the data acquisition system so that a temperature measurement is performed at the same time that the measurements from the solar calorimeter are collected.

A2. Calibration of Solar Calorimeter Wall Heat Flux

A2.1 Calibration of Solar Calorimeter Wall Heat Flux - The heat flux through the solar calorimeter walls can be estimated by various means, which differ in accuracy and level of effort. The heat flux of the calorimeter shall be estimated during the design of the calorimeter to refine the final construction. In addition, the predicted heat flow can then be compared to the actual values measured by means specified in this Annex as a gauge of meeting the design goals. The procedures described below assume that the solar calorimeter is designed to have generally uniform airflow and temperatures at each surface of the calorimeter walls.

A2.2 Model Prediction

A2.2.1 The following equations represent one method of estimating the heat flow through the walls of a five-sided rectangular calorimeter made of homogeneous material. Langmuir³⁰ estimates the solar calorimeter wall heat flow to be equivalent to one-half that of a closed six sided box formed by placing two of the open sided boxes together. The heat flow for the five-sided box is given by:

$$q = \frac{\lambda_{\text{eff}} \cdot A_{\text{eff}} \cdot (t_{\text{in}} - t_{\text{out}})}{L} \quad (\text{A2.1})$$

Where, the effective area normal to heat flow, m², is given by:

$$A_{\text{eff}} = A_{\text{in}} + 0.54 \cdot L \cdot \Sigma e_i + 0.60 \cdot L^2 \quad (\text{A2.2})$$

And,

- A_{in} = solar calorimeter inside surface area, m²,
- L = solar calorimeter wall thickness, m,
- λ_{eff} = solar calorimeter effective wall thermal conductivity, W/mK,
- t_{in} = solar calorimeter inside wall surface temperature, K,
- t_{out} = solar calorimeter outside wall surface temperature, K,
- Σ e_i = sum of all (total of 8) solar calorimeter interior edge lengths formed where two walls meet, m.

A2.2.2 There are numerous two-dimensional computer analysis tools that can be used to estimate the heat flow through the calorimeter walls (i.e., THERM). Typically, these computer

³⁰ Langmuir, I., Adams E. Q., and Meikle F. S., "Flow of Heat Through Furnace Walls" *Transactions American Electrochemical Society*, Vol. 24, 1913, pp. 53-84.

programs require detailed cross sections of the solar calorimeter wall at all locations that are representative of the calorimeter wall construction. The thermal conductance and emittance of all the building components in those cross sections are input into the computer models to determine the heat flow through those sections. The total heat flow through the calorimeter walls is determined by area weighting the computed heat flow through the various cross sections.

- A2.2.3 The most accurate method of calculating the heat flows in and out of the calorimeter is by using three-dimensional computer analysis tools (i.e., HEATING 7, FIDAP). These computer programs allow detailed analysis of the convection and radiation environments encountered in a solar calorimeter. They are also very difficult and time consuming to use. Typically, these computer programs require detailed three-dimensional computer drawings of the calorimeter wall construction, as well as the thermal conductance and surface heat transfer coefficients of all the building components.

A2.3 Solar Calorimeter Calibration

- A2.3.1 The procedure given in this section outlines the steps required to verify the proper output of the calorimeter wall thermopile, and to obtain the initial relationship between solar calorimeter wall heat flow, calorimeter loss, and its transducer output. The latter series of calibration tests addresses the technique that will yield the heat flow relationship as a function of the transducer output including a zero offset, if present. In addition to the verification tests described in this Annex, the surround flanking loss calibration tests described in Annex A3 must be performed before testing actual specimens.

NOTE A2.1 - Alternate procedures to evaluate the slope and offset of the calorimeter heat flow and flanking loss are acceptable, if documented and verified experimentally.

- A2.3.2 To perform both of these calibration tests, a calibration panel, as described in Annex A6, must be instrumented and installed in the solar calorimeter. This calibration panel must fill the available dimensions of the test frame. The calorimeter wall calibration cannot be performed using a test specimen smaller than the solar calorimeter opening.
- A2.3.3 It is essential that the air velocities, power inputs and temperatures for the solar calorimeter, and guard be held constant throughout each calibration test. By holding all the control parameters constant, the operator decreases the variability of the surface heat transfer coefficients on the calibration panel during the test.

A2.4 Verifying Calorimeter Wall Transducer Null Offset

- A2.4.1 This procedure outlines a verification test required to confirm that the solar calorimeter wall transducer output is zero when there is no heat flow through the solar calorimeter walls. This method helps determine if the thermopile used to measure the temperature difference (and heat flow) across the calorimeter wall is wired properly. The construction of the calorimeter wall thermopile is described in Section 6.2.4.1.1, and the proper operation of the thermopile shall be verified before additional calibration tests are

performed.

A2.4.2 Install a calibration panel, as specified in Section A6, in the thermal chamber. Do not start any fans, heaters, or instrumentation, which generates heat (i.e., hot wire anemometers), and shade the entire solar calorimeter from solar irradiation. Record the ambient air temperature, the temperatures of the air, absorber plate surfaces, and surround panel in the calorimeter, and the output from the calorimeter wall transducer (thermopile) for at least 24 hours after the calorimeter has reached steady state conditions with the surrounding ambient environment.

A2.4.3 Once the solar calorimeter has reached steady state conditions with the ambient environment (this may take days to achieve); the surface and air temperatures in the solar calorimeter, and guard (if present) should be close to each other. Therefore, the output from the calorimeter wall transducer should be close to zero. There may be a small cyclic output from the calorimeter wall transducer based on the diurnal fluctuation of temperature in the surrounding environment, but the average output over 24 hours should be zero. If the average output from the calorimeter wall transducer is not close to zero, then the wiring of the calorimeter wall thermopile should be checked and repaired, if necessary, before additional calibrations or calibration tests are performed.

A2.5 Calibration of Calorimeter Wall Transducer

A2.5.1 This describes the process to determine the relationship between the output from the calorimeter wall transducer and the heat flow through the calorimeter walls when the temperature difference across the calibration panel may be close to zero. The environmental conditions generated during this test are likely to be different from actual test conditions. The results from these tests are used to establish the value of the coefficient that is multiplied by the output from the calorimeter wall transducer to determine the calorimeter wall loss. Any offset due to flanking loss or other anomalies is determined by the calibration tests described in Annex A3.

A2.5.1.1 Perform a minimum of three calibration tests with the calorimeter air temperature equal to (± 5.0 °C (± 9.0 °F)) the ambient air temperature, but with the guarding temperature set to different values. The calorimeter air temperature shall be heated with the assistance of an auxiliary metered heater placed inside of the solar calorimeter. Otherwise the calorimeter controls shall be adjusted such that the fluid flow rate and temperatures are the same as during testing. The ambient temperature outside of the solar calorimeter shall not vary more than ± 5.0 °C (± 9.0 °F), and the heat exchanger fluid flow rate shall not vary more than 1.0% over the duration of a test. In this configuration, negligible heat, Q , is flowing through the calibration panel, and thereby, all the net heat into the calorimeter is lost (or gained) through the calorimeter walls.

A2.5.1.2 Separate calibration tests need to be performed with the guarding temperature set at different values, but with the solar calorimeter air temperature held constant. The fans generating the airflow inside of the calorimeter shall also be set at constant speeds. It is recommended that at a minimum, one test be performed with the guarding temperature above the calorimeter air temperature, one test with the guarding temperature equal to the calorimeter air temperature, and one test be performed with the guarding temperature

below the calorimeter air temperature.

A2.5.1.3 For the condition where the surface temperature difference across the calibration panel is close to zero, the flanking loss is also zero, and the heat balance can be determined. By plotting the heat flow versus the output from the calorimeter wall thermocouple, the slope and the zero offset can be determined.

A2.5.2 The measured calorimeter wall heat flow shall also be compared to the theoretical value calculated in Annex A2.2. If there is a significant discrepancy between the measured and calculated heat flow, conduct an investigation to identify the reason for this discrepancy. If all systems are operating satisfactorily, use the measured coefficients when performing the calibration tests specified in Annex A3.

A3. Surround Panel Flanking Loss Calibration

- A3.1** *Calibration of Surround Panel Flanking Heat Flux* – When a test specimen is installed in the surround panel of a solar calorimeter, the heat flux through the aperture of the calorimeter is a combination of the heat flux through the test specimen, the heat flux through the surround panel, and any flanking heat flux at the edge of the aperture where the surround panel is in contact with the solar calorimeter walls. This flanking heat flux is determined for each thickness of surround panel using the calibration test method specified in this Annex. The surround panel flanking heat flux tests shall be performed after the solar calorimeter wall heat flux transducer coefficient has been determined using the procedures outlined in the previous Annex.
- A3.2** For these calibration tests, the temperature of the outdoor face of a calibration panel, which is constructed of the same material as the surround panel, is maintained at a higher temperature than the interior air temperature within the solar calorimeter. These tests are performed under full sunlight.
- A3.3** To perform flanking loss calibration, install and instrument a calibration panel of the appropriate thickness in the solar calorimeter as specified in Annex A6. A separate calibration test is required for each surround panel thickness and assembly.
- A3.4** Track the sun to within $\pm 5^\circ$ of normal to the source of solar irradiation. Record the data at a minimum of five minute intervals until steady state conditions are reached per Section 7.4.
- A3.5** From this data the flanking loss can be calculated from the following equations:

$$Q_{fl} = Q_{fluid} - Q_{walls} - Q_{aux} - Q_{sp} \quad (A3.1)$$

Where:

- Q_{fluid} = heat flux extracted from the liquid W, (Btu/hr)
 Q_{wall} = heat flux through the walls of the calorimeter W, (Btu/hr)
 Q_{aux} = energy contributed by auxiliary sources W, (Btu/hr)
 Q_{sp} = heat flux through the surround panel W, (Btu/hr)
 Q_{fl} = flanking heat flux of surround panel W, (Btu/hr)

A4. Recommended Practice for Estimation of the Testing System Time Constant

A4.1 General Considerations

A4.1.1 The time required to conduct a solar calorimeter test is determined, in part, by the speed of response of the testing apparatus and the specimen's response to changes in its environment. One measure of this response to change is the time constant, τ , of the system. The time constant of the system is the time required for the system to respond to within 37 % (1/e) of its final value of response, usually energy flow, after a step change in forcing condition, usually upon sudden exposure to direct solar irradiation. As specified in Section 7.4, a minimum of five time constants of consecutive, uniform data must be collected to determine if steady state conditions exist. Therefore, it is necessary that an accurate measure of the effective time constant, τ_{eff} , of the operating solar calorimeter system be determined.

A4.1.2 The operation of the solar calorimeter is an energy transfer problem. Therefore, it appears logical that the time controlling factors for the solar calorimeter test would include:

- the heating and cooling capacity for the apparatus;
- the air circulation patterns and velocity;
- the internal energy storage capacity of the test chamber equipment;
- the thermal diffusivity and resistance of the materials used to construct the chambers;
 - the effective solar absorptance of the absorber plate, and calorimeter shell exposed to direct irradiation;
 - the effectiveness of the absorber plate as a heat exchanger with the interior air;
 - the specimen solar transmittance, and absorptance
- the specimen geometry;
- the specimen thermal diffusivity and resistance; and,
- the specimen energy storage capacity.

Also, any transient effects such as residual moisture change or the onset of convection within specimen might increase the time for stabilization for a test.

A4.2 Testing System Time Constant Evaluation

A4.2.1 The solar calorimeter time response is controlled by either the apparatus design or the assembled properties of the specimen. For test purposes, if the apparatus time constant, τ_{ap} , is greater than specimen time constant, τ_{s} , the test will be controlled by the value of τ_{ap} . If however, $\tau_{\text{ap}} < \tau_{\text{s}}$, then the specimen response will be the controlling factor in determining whether the test is complete. The apparatus time constant, τ_{ap} , is determined by experimental measurement as described in Section A4.3, and the specimen time constant, τ_{s} , is calculated as specified in Section A4.4. Note, however, that the two time constants may not be completely distinct and independent.

A4.3 Response of the Apparatus

A4.3.1 The design of the apparatus must include consideration of the speed of response of the solar calorimeter to changing test conditions and the thermal lag caused by the heat capacity of the internal equipment. The speed of response of the apparatus, or time constant, τ_{ap} , is fixed by the design and, for a properly designed system should, ideally, be less than the specimen time constant. Since the test apparatus is generally complex compared to the specimen, and since it does not change with the specimen, the apparatus time constant, τ_{ap} , can be determined by experimental means.

A4.3.2 Experimental Determination of the Apparatus Time Constant

A4.3.2.1 The time constant of the apparatus, τ_{ap} , can be empirically determined by measuring the speed of response of the solar calorimeter with a specimen installed. As discussed in A4.1.2, for any experimental setup, the measured system time response is the sum of the time responses of the individual parts. Any attempt to measure, experimentally, the effective time constant, τ_{eff} , will, in fact, be determining the combined response of the apparatus constant, τ_{ap} , and the specimen time constant, τ_s . Therefore, if the time constant of the specimen can be forced to be significantly less than the time constant of the apparatus, then the apparatus time constant, τ_{ap} , can be approximated using the simple experiment outlined in Section A4.3.3.

A4.3.2.2 Although it is impossible to create a specimen that has zero specific heat capacity and 100% solar transmittance, a specimen can be developed that has a low thermal resistance, low energy capacity, and high solar transmittance. By examination of Eq. A4.1, the specimen sample will have a lower time constant if the specific heat capacity ($M_s \bullet C_s$) is kept low, since A_s and h are fixed by the apparatus design. Therefore, to establish a good estimate of the minimum time constant for the apparatus, one must use a homogeneous, lightweight, high solar transmittance specimen, such as single pane clear glazing. This specimen design should produce the shortest test time constant for the testing system.

A4.3.2.3 Therefore, the recommended practice is to measure the apparatus response to a step change in solar irradiation using a low mass, high solar transmittance specimen, and then use those results to determine the shortest time constant of the system. The time constant of the system would then have to be increased if the time constant of the specimen is determined to be greater than the time constant of the apparatus.

A4.3.3 *Procedure for Experimental Time Constant Determination* - The following experimental procedure is recommended for determining the time constant for a solar calorimeter.

A4.3.3.1 Procure a specimen having the highest solar transmittance, the lightest weight, and largest size that can be tested within the practical limits of the test apparatus.

A4.3.3.2 Install and seal the specimen in the solar calorimeter, shade the entire solar calorimeter from direct sunlight, and initiate test conditioning. Although the solar calorimeter is initially shaded from direct solar irradiation, the face of the solar calorimeter shall be pointed normal to the source of direct sunlight. For the initial test conditions, set the air and inlet fluid temperatures in the solar calorimeter to the typical set points. (See Note A9.1).

- A4.3.3.3 Set up the data acquisition system to record all test parameters at a minimum of one (1) minute intervals and begin recording data. Initiate the solar calorimeter tracking system to orient the solar calorimeter to within ± 5 degrees of normal to the direct solar irradiation. The time constant tests shall be conducted when the levels of solar irradiation are fairly constant or decreasing; i.e., outdoor solar calorimeters need to be within one hour of solar noon or shortly thereafter.
- A4.3.3.4 Continue monitoring the test data until steady state is reached. For this determination use a minimum of 5 consecutive ten-minute time averages to establish steady state. (Refer to Section 7.4).
- A4.3.3.5 Once steady state conditions have been achieved; quickly remove the shading device from in front of the solar calorimeter so that the test specimen and solar calorimeter are in full direct sunlight. Allow the temperature control system to adjust the fluid temperatures to maintain the inside air temperature within the temperature limits used for testing. Record the time at which this change occurs, and continue to monitor test data.
- A4.3.3.6 Continue monitoring the test data until steady state is reached (See Section 7.4). For this determination use a minimum of 5 consecutive ten-minute time averages to establish steady state.
- A4.3.3.7 Plot the time versus temperature and net sample energy flow rate (SHGC) for the period from shortly before the shading device is removed to the second time the solar calorimeter reaches steady state.
- A4.3.3.8 Determine the elapsed time from the time that the shading device is removed, in which the one-minute averages of temperatures and energy flow was 63.2% of the final value.
- A4.3.3.9 Determine the elapsed time from the time that the shading device is removed, in which the one-minute averages of temperatures and energy flow was 86.5% of the final value.
- A4.3.3.10 The maximum difference in times for Step A4.3.3.8 and A4.3.3.9 is equal to the time constant for the test system, τ_{eff} . The time constant of the solar calorimeter apparatus shall not be considered to be less than 10 minutes.

NOTE A4.1 - For most circumstances, the time constant is independent of the magnitude of the incident solar irradiation, or the energy flow of the system. The controlling factor for the time constant will be the energy capacity of the air and fluid systems, and thermal resistance and solar absorbance of the solar calorimeter, absorber plate, and specimen. Typically, solar calorimeters, which have suddenly been exposed to solar irradiation reach steady state condition faster than when the solar irradiation is suddenly shaded, and the solar calorimeter must cool to reach a new steady state condition. In this circumstance, the rate of energy input by solar irradiation is much greater than the rate of energy flux that can be removed by the fluid flow and lost through the apparatus. The measured time constant of solar calorimeter system would be different depending on whether the solar calorimeter is suddenly exposed to direct sunlight, or suddenly shaded during the time constant test. Since the heat flux in a solar calorimeter is primary driven by direct solar irradiation during test, the apparatus time constant should be determined while solar irradiation is incident on the test specimen. For this reason, it is best to perform time constant tests where the shading device is suddenly removed to expose the solar calorimeter to direct solar irradiation as opposed to suddenly shading a solar calorimeter that has previously reached steady state in full sunlight.

A4.4 Calculation of Specimen Time Constants

A4.4.1 Since the value of the overall time constant, τ_{eff} , determined in the previous section is for the low thermal resistance, low energy capacity, high solar transmittance specimen, it may be necessary to determine the time constants for other specimen constructions. Of course, one could repeat the experimental procedure of A4.3.3 for every specimen. However correct, this approach would be expensive.

A4.4.2 An alternative is to calculate the time constant of the specimen based upon the simple formula shown in Eq. A4.1. Fortunately, the time constant of a homogeneous system, such as a simple specimen, can be approximated by a first order equation, Eq. A4.1.

$$\tau_s = \frac{M_s \bullet HC_s}{h' \bullet A_s} \quad (\text{A4.1})$$

where:

- τ_s = specimen effective time constant, hr
- M_s = mass of the composite specimen, kg.
- HC_s = equivalent composite specific energy, W hr/(kg•K)
- A_s = energy transfer area, m²
- h' = the composite surface coefficient which includes an estimate of the internal energy flow resistance, W/(m²•K)

and:

$$1/h' = (1/h_s) + (R) \quad (\text{A4.2})$$

- h_s = the surface coefficient, W/ (m²•K)
- R = the estimated specimen resistance,(m² •K) /W

A4.4.3 This procedure still may be too complex for a typical window that has many structural members with significantly different energy flow rates. A further simplification for our purpose is to estimate the time constant for each of the simple energy flow paths and then combine them into an "averaged" time constant for the complex structure. Review of the ASHRAE Fundamentals volume and other resource books on transient energy transfer, shows that the common method for combining the energy transfer parameters for a complex structure is to add the system path effects together using a parallel path technique. Applying this principle to the calculation of the time constant yields the following:

$$A_s / \tau_s = A_1 / \tau_{s1} + A_2 / \tau_{s2} + \dots + A_i / \tau_{si} \quad (\text{A4.3})$$

where:

- A_s = overall specimen area, m²
- A_i = component energy path area, m²
- τ_s = specimen composite time constant, hr
- τ_{si} = specimen path component time constant, hr

A4.5 Overall Test Time Constant

A4.5.1 The effective overall time constant is used to fix the time periods required for data acquisition and determination of final system stability. Above, methods of estimating the apparatus time constant, τ_{ap} , and the composite specimen time constant, τ_s , for a solar calorimeter system. As outlined in A4.2, the remaining step is to choose the effective overall time constant that controls our process. This choice is made as follows:

A4.5.1.1 If $\tau_s \gg \tau_{ap}$, then use $\tau_{eff} = \tau_s$, or

A4.5.1.2 If $\tau_{ap} \gg \tau_s$, then use $\tau_{eff} = \tau_{ap}$, or

A4.5.1.3 If $\tau_{ap} \approx \tau_s$, then use the larger of τ_{ap} or τ_s .

A4.5.2 For purpose of ease of calculation and data logging, the period of the scan time used for the test may be approximated by rounding up to the nearest simple fraction of five minute intervals. For example, if the time constant is determined to be 8.5 minutes, use 10 minutes. Or, if the time constant is 12.5 minutes, use 15 minutes. Remember this is a guide for testing and an exact determination is not required.

A4.5.3 *Alternative Methods* - Often a laboratory may be testing only one type of specimen. In these cases, a simplified method of determining the system time constant can be utilized. The following is an alternate method.

A4.5.3.1 One alternate approach utilizes a high thermal resistance, high energy capacity, low solar transmittance system to determine the system time constant. By a line of analysis similar to that illustrated above, a frosted glass block wall, for example, would yield a very long specimen time constant. This time constant might significantly exceed the time constant of the apparatus. Therefore, this alternate method is to measure the time constant of the apparatus with the highest-mass specimen installed, and use that time constant for all specimens that are less massive. While this would eliminate the need to calculate the time constant of massive systems, it also would increase the time of testing required for less massive specimens.


A5. Calibration Transfer Standard Tests

A5.1 Calibration Transfer Standard Tests – Calibration Transfer Standards covering the range of test specimen sizes expected shall be tested at the using the procedures specified in Section 5 and Annex A1 of ASTM C 1199 using the following environmental conditions:

A5.1.1 Interior Air Temperature = 75 °F

A5.1.2 Weather Side Air Temperature = 90 °F (See Figure Below)

A5.1.3 Surface Heat Transfer Coefficients and Tolerance as specified in Section 4.2 of NFRC
102

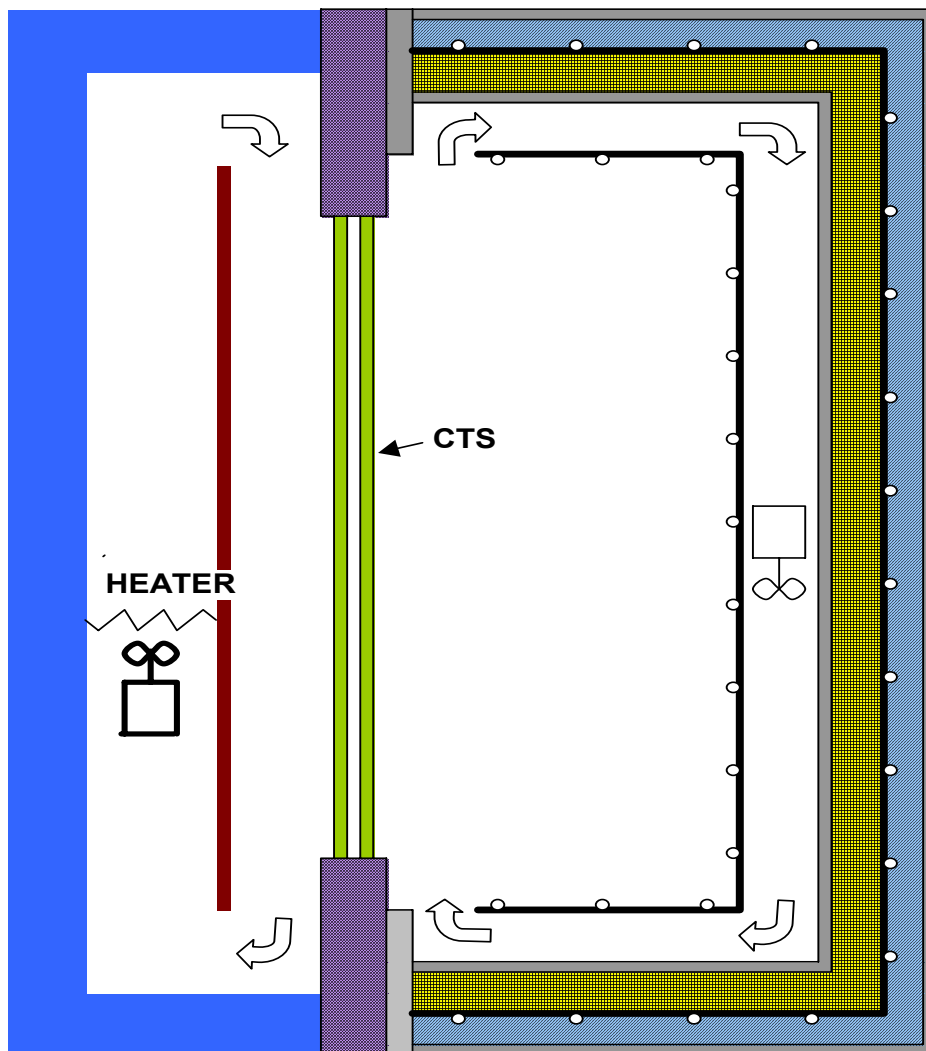

A6. Design and Construction of the Solar Calorimeter Calibration and Surround Panels

A6.1 The procedures outlined in Annexes A2-A3 outline the steps required to quantify the relationships for calorimeter wall loss and flanking loss. For the experimental analysis of these parameters, a calibration panel that fits the calorimeter opening is required. The surround panels required for measurement of specimens smaller than the opening of the solar calorimeter are identical in construction to the calibration panels. The exception is that the calibration panel is continuous and the surround panel has a hole, at its center, large enough to hold the specimen. Since the construction, but not necessarily the thickness, is identical for both panels, this section presents instructions on the fabrication and instrumentation of both calibration and surround panels. For purposes of discussion below, the word “panel” will apply to both types.

A6.2 The need to determine the panel heat flow, Q , accurately requires that the panel be designed to act as a heat flux transducer with an transducer output proportional to the temperature difference, Δt , which is in turn proportional to the total heat flow through it. This consideration is the basis for the specific recommendations, which follow.

A6.3 Construction and Instrumentation of the Panels

A6.3.1 The calibration panels must be constructed from a uniform thickness of a homogeneous and stable material of low thermal conductivity. Suitable materials are high-density glass fiber or polystyrene boards laminated together as necessary. The assembled panel must be non-hygroscopic to minimize changes in its thermal resistance with ambient humidity conditions. In addition, the assembled panel shall be opaque in the visible spectrum.

A6.3.2 Surround panels may be fabricated by sandwiching layers of homogeneous insulation between layers of rigid materials such as plywood or plastic. Such surround panels, though non-homogeneous, are uniform in the direction perpendicular to the direction of heat flow and are characterized in the same manner as homogeneous panels. Surround panels must have adequate strength to support the weight of the specimens to be tested.

A6.3.3 If the panel is assembled from multiple pieces of identical material, thickness and conductivity, then the joints between the pieces shall be sealed with tape or caulk that is at the same solar absorbance and emittance (± 0.1) as the panel surface to which it is attached. Tape shall not be placed more than 50 mm (2.0 in.) from the edge of the joint. If rigid insulation is used as the core material, there is an opportunity to use a “tongue and groove” or a lapped joint to help minimize the air infiltration through the joint.

NOTE A6.1 – A recommended surround panel core material is expanded polystyrene (bead board) having a density in excess of 20 kg/m^3 , which has been aged unfaced in the laboratory for a minimum of 90 days. Polyisocyanurate or other fluorocarbon-expanded cellular foam insulations are not recommended as their thermal conductivity has been shown to significantly change over time. Suitable facing materials are approximately 3 mm thick heat-resistant rigid ABS thermoplastic sheets with smooth or matte finish faces or a similar thickness hi-impact polystyrene plastic sheets. The surround panel may need to have some horizontal and vertical saw cuts made in the cold side facing material to

minimize the effects of differential thermal expansion between the cold and hot side faces. The thin cuts should be covered with similar solar absorptance and emittance tape strips to provide a smooth surface to the weather and room side air streams.

A6.3.4 Surround Panels

A6.3.4.1 Surround panels are required for testing specimens smaller than the metering area.

Their construction is similar to that of the calibration panels.

A6.3.4.2 The surround panel aperture in which the specimen is installed should fit the specimen snugly. Cracks greater than 1/8 in. width shall be filled with insulation and caulked or taped at the surround panel surfaces to prevent air leakage. It is desirable that the insulation used to fill cracks has the same conductivity and thickness as the surround panel assembly. The edge of the opening in the surround panel may be covered with nonreflecting tape to minimize surface damage of the exposed core insulation. Surround panels used for calibration testing must have the specimen aperture filled with the same material, thickness, thermal conductivity and assembly as the adjacent surround panel during the calibration tests. The joint between the perimeter surround panel and the panel filling the aperture shall be flush and sealed with tape or caulk as described above.

A6.3.4.3 The thickness of the surround panel shall be at least the maximum thickness of the specimen, and shall be in no circumstances less than 100 mm (4 in.). Also, the maximum thickness of the surround panel shall be no more than 25 mm (1 in.) greater than the maximum thickness of the test specimen. That is, for test specimen maximum thickness less than or equal to 100 mm (4 in.), the surround panel thickness shall be 100 mm (4 in.). For test specimen maximum thickness greater than 100 mm (4 in.), the surround panel thickness should be equal to the specimen thickness rounded to the next higher whole inch.

A6.3.4.4 The restriction of surround panel thickness is to limit the flanking loss through the surround panel at the uncovered areas of its aperture. Other special instances, for example a window designed to be set a few inches outward from the plane of the inner surface of a wall, require special calibration of the surround panel. In this case, a calibration panel of known thermal conductance must be in the same position at the juncture with the surround panel aperture as the window.

A6.3.4.5 Unless specifically required for test specimen mounting purposes (very high mass test specimens), no thermal anomalies (that is, thermal bridges like wood or metal) shall exist in the surround panel. It may be necessary, in some cases, to incorporate framing in the surround panel to support heavy specimens such as heavy-duty metal frame windows or masonry sections. Framing members must be kept away from the specimen aperture and away from the point of contact of the metering walls so as not to contribute excessively to lateral heat transfer at these locations. Such non-uniform surround panels must be characterized after the hole is cut using calibration blanks of the same thickness and thermal conductance as the insulated part of the surround panel. In those specific situations where the surround panel is not homogeneous, detailed drawings and description of the surround panel construction, along with the measured calibration results shall be included with the test report.

A6.4 Instrumentation of Calibration and Surround Panels

- A6.4.1 The surface temperature sensors used to measure the temperature difference across the panel shall be permanently installed uniformly flush with or just under its surfaces. When thermocouples are used, they may be connected; (1) as a differential thermopile for determination of the surround panel temperature difference, or, (2) as individual thermocouples for exploring temperature distributions on the faces of the panel. At a minimum density, there shall be five temperature sensors per square meter installed on each panel surface. The temperature sensors shall be placed in the center of equal sized areas, or their output shall be area weighted to determine the average temperature of the surround panel surface. At a minimum, there shall be four temperature sensors on each face of the surround panel. These four thermocouples shall be located at positions bisecting the sides of the rectangle. It is recommended that additional thermocouples be located at positions bisecting the four lines from the corners of the specimen aperture to the corresponding corners of the metering area. A suitable temperature sensor arrangement shall be chosen for non-uniform surround panels that provide representative average surface temperatures. This is particularly important when natural convection is used and air temperatures and film coefficients vary over the metering surface. If framing members are used, an area-weighted average of temperatures measured over the members and away from them is necessary. The panel, which acts as a heat flow meter, shall be calibrated so that the heat flow is known as a function of the average temperature difference (or thermopile output voltage) across it or as indicated by the permanently installed thermocouples.
- A6.4.2 Surround panels being used as calibration panels (i.e., the specimen aperture is filled with insulation) shall have a uniform layout of temperature sensors across the surround panel surface and the surface of the material filling the specimen aperture. It is sometimes more difficult to uniformly instrument the surround panel when the specimen aperture is filled with an actual specimen, which often has its own instrumentation scheme (i.e., as specified in ASTM E 1423).
- A6.4.3 To protect the panel and the permanently installed thermocouples, the surfaces must be impervious to air. In addition, the panel shall be opaque to visible light. A permanent coating or thin facing on each face of the panel is desirable. However, the coating or facing must be of low lateral conductance so that it does not contribute excessively to lateral heat transfer at the juncture with the specimen or at the boundary of the metering area. The solar absorbance and emittance of the panel surfaces shall be uniform and unchanged after calibration. In all cases, the emittance of the panel surfaces shall be high ($\epsilon > 0.8$), and the solar absorbance be low ($\alpha < 0.2$). The adhesive, caulk or tape used to mount the temperature sensor instrumentation shall have the same solar absorbance and emittance as the surrounding surface (± 0.1). Surface temperature sensors and attachment techniques shall meet the requirements specified in Section 6.10 of ASTM C 1363. Surface temperatures shall be measured to ± 1.0 °C (± 1.8 °F).
- A6.4.4 It is probable that many specimens to be tested are inhomogeneous or non-uniform in construction for structural reasons, and in consequence that the local thermal conductance differs considerably at different frontal areas of the element. The variations are inherent, and the result of the test is an average conductance or transmittance value for the total construction, provided that the conductance variations at edges do not seriously impair

the validity of using the surround panel as an adequate heat flow meter. This matter varies with each case and therefore must rest on the judgment and technical experience of those conducting the test measurement. A useful guiding principle is that nothing should be incorporated in, or omitted from, a specimen being tested that would make it not representative of the assembly that would be found in actual installation in service. For example, if a metal window ordinarily is installed with inset wood framing, the test specimen should include just so much of the wood framing as is properly chargeable to it.

A6.5 Calibration of the Panel as a Heat flow Transducer

- A6.5.1 Characterization of any panel material, whether used for calibration, surround panel, or as a transfer standard for windows testing (See ASTM C 1199) shall be made by means of thermal tests on a representative sample of the assembled panel, their individual components, or tests on the entire panel. For this reason, it is required that the thermal resistance of a sample assembly of the calibration or surround panel be measured in a guarded hot plate (ASTM C 177) or a heat flow meter apparatus (ASTM C 518) at a minimum of three temperatures over the range of conditions at which the panel will be used (e.g., 2 °C, 24 °C and 43 °C [35° F, 75° F and 110° F]).
- A6.5.2 The calibration should cover the range of mean temperatures at which the panel will be operated during the testing. At any one surround panel mean temperature, there should be little variation of $Q_{sp} / \Delta t$ with Δt , but $Q_{sp} / \Delta t$ may vary slightly with mean temperature due to the change of thermal conductivity to the surround panel material.

NOTE A6.2 – Additional uncertainty may arise due to the possible influences of the specimen in causing two or three-dimensional heat flow at its boundary with the surround panel and thus affecting the surround panel heat flow in regions adjacent to the element. Surround panel heat flow, determined under a given set of conditions with a calibration standard in place, may change when the specimen is installed, even though the test conditions remain unchanged. If the specimen is expected to have this influence, an attempt should be made to evaluate its impact on the desired accuracy of the test.